

Fig. 1

09715354 111700



Fig. 2

09745354 44700



48


42

44

007777 4555760

11
11

00715354-111700

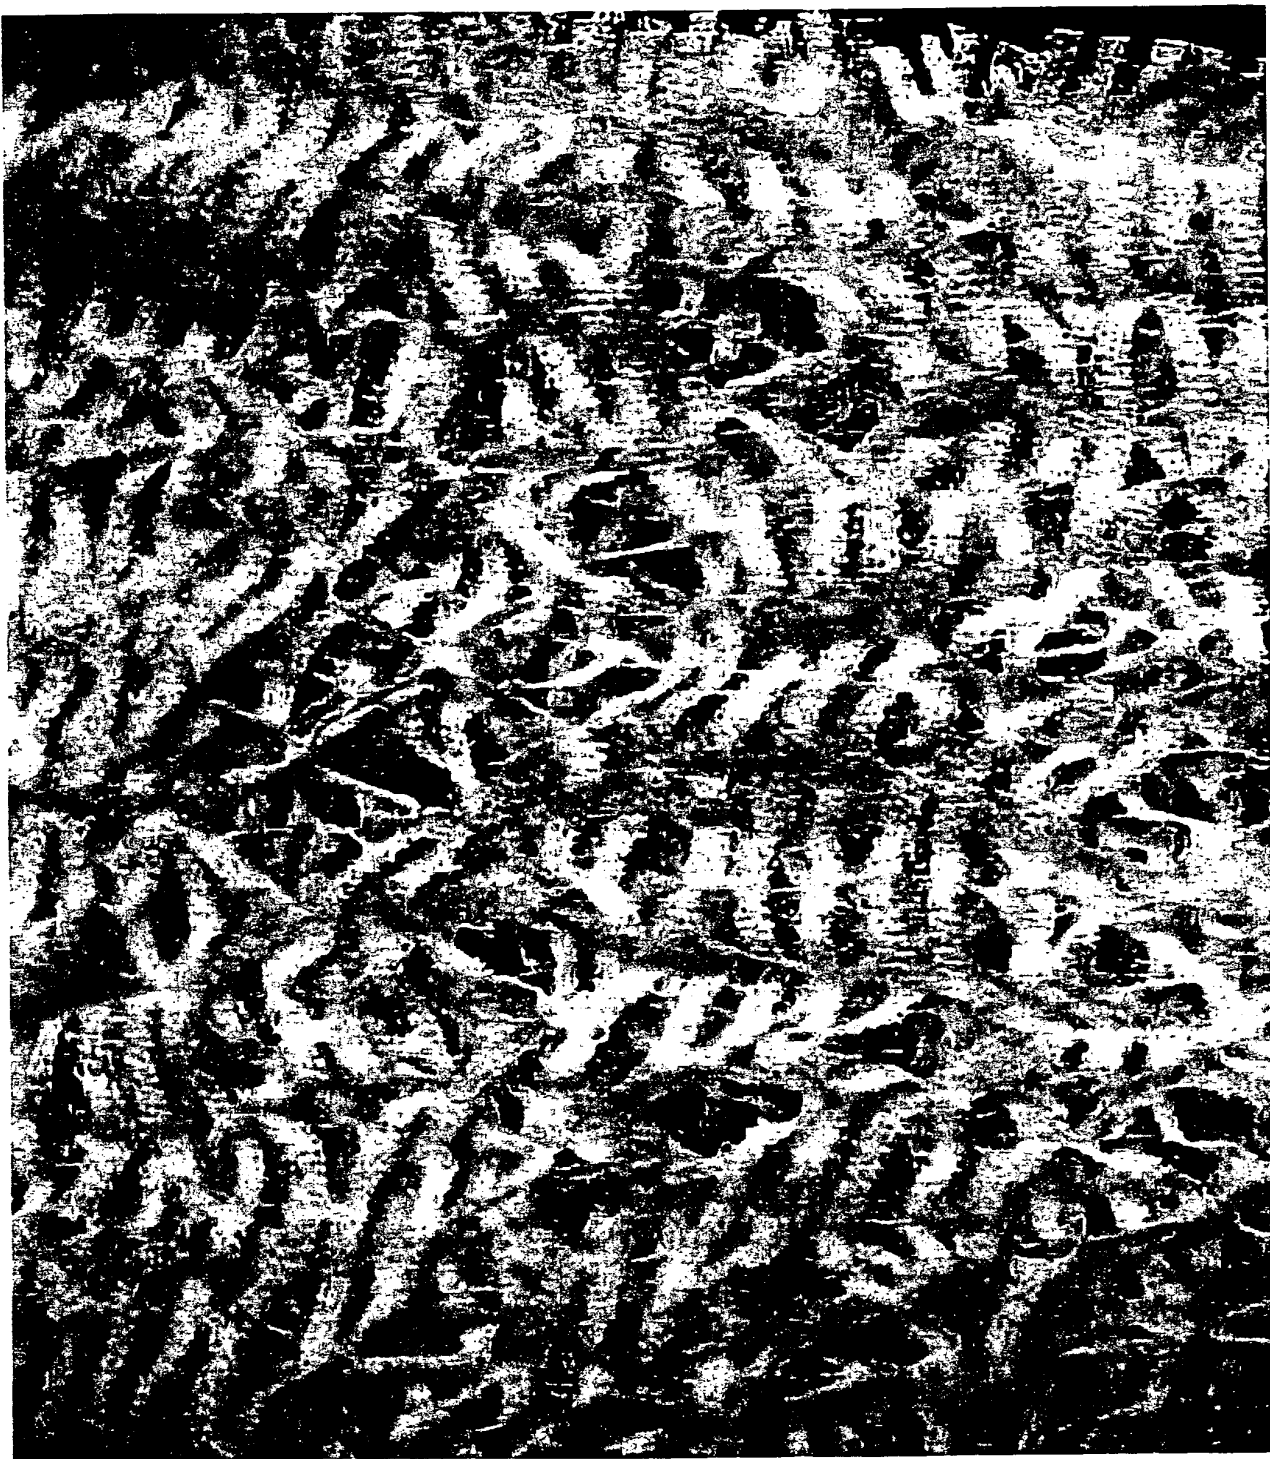

35

42

48

44

00715354.11700




40 ^


004777 45EST260



09715354 11700

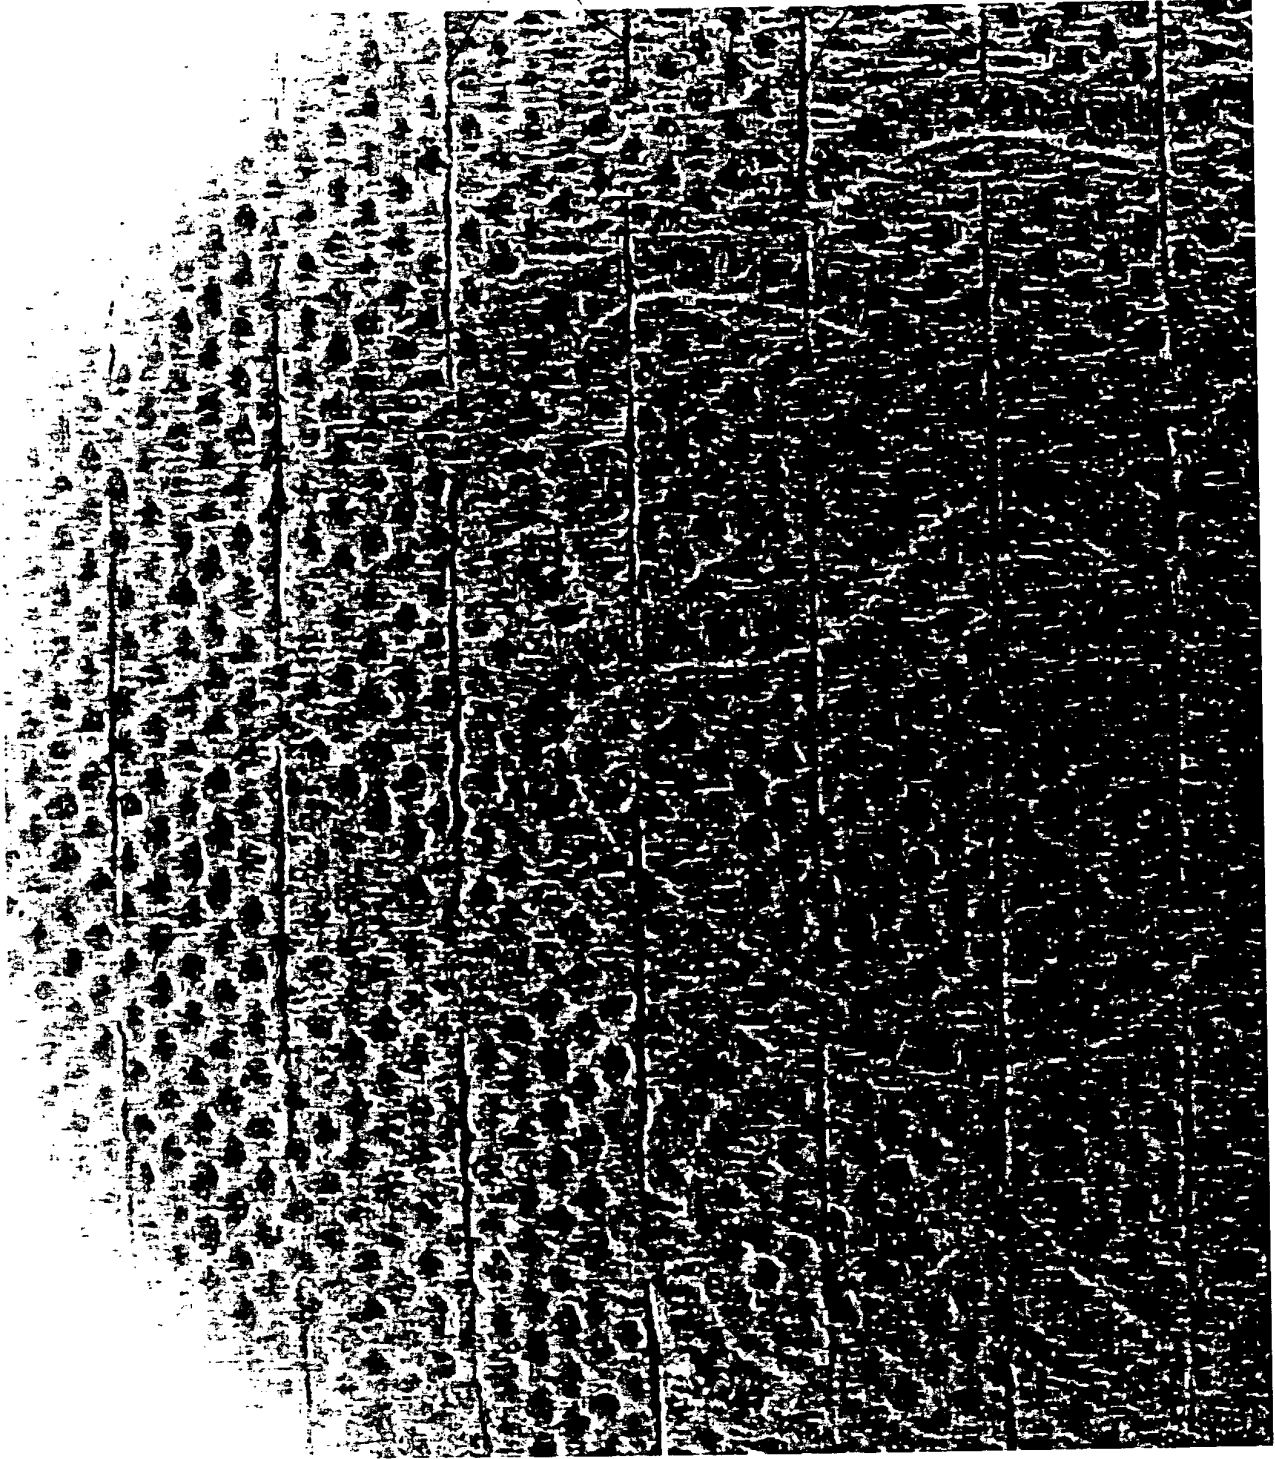

004411 45557660

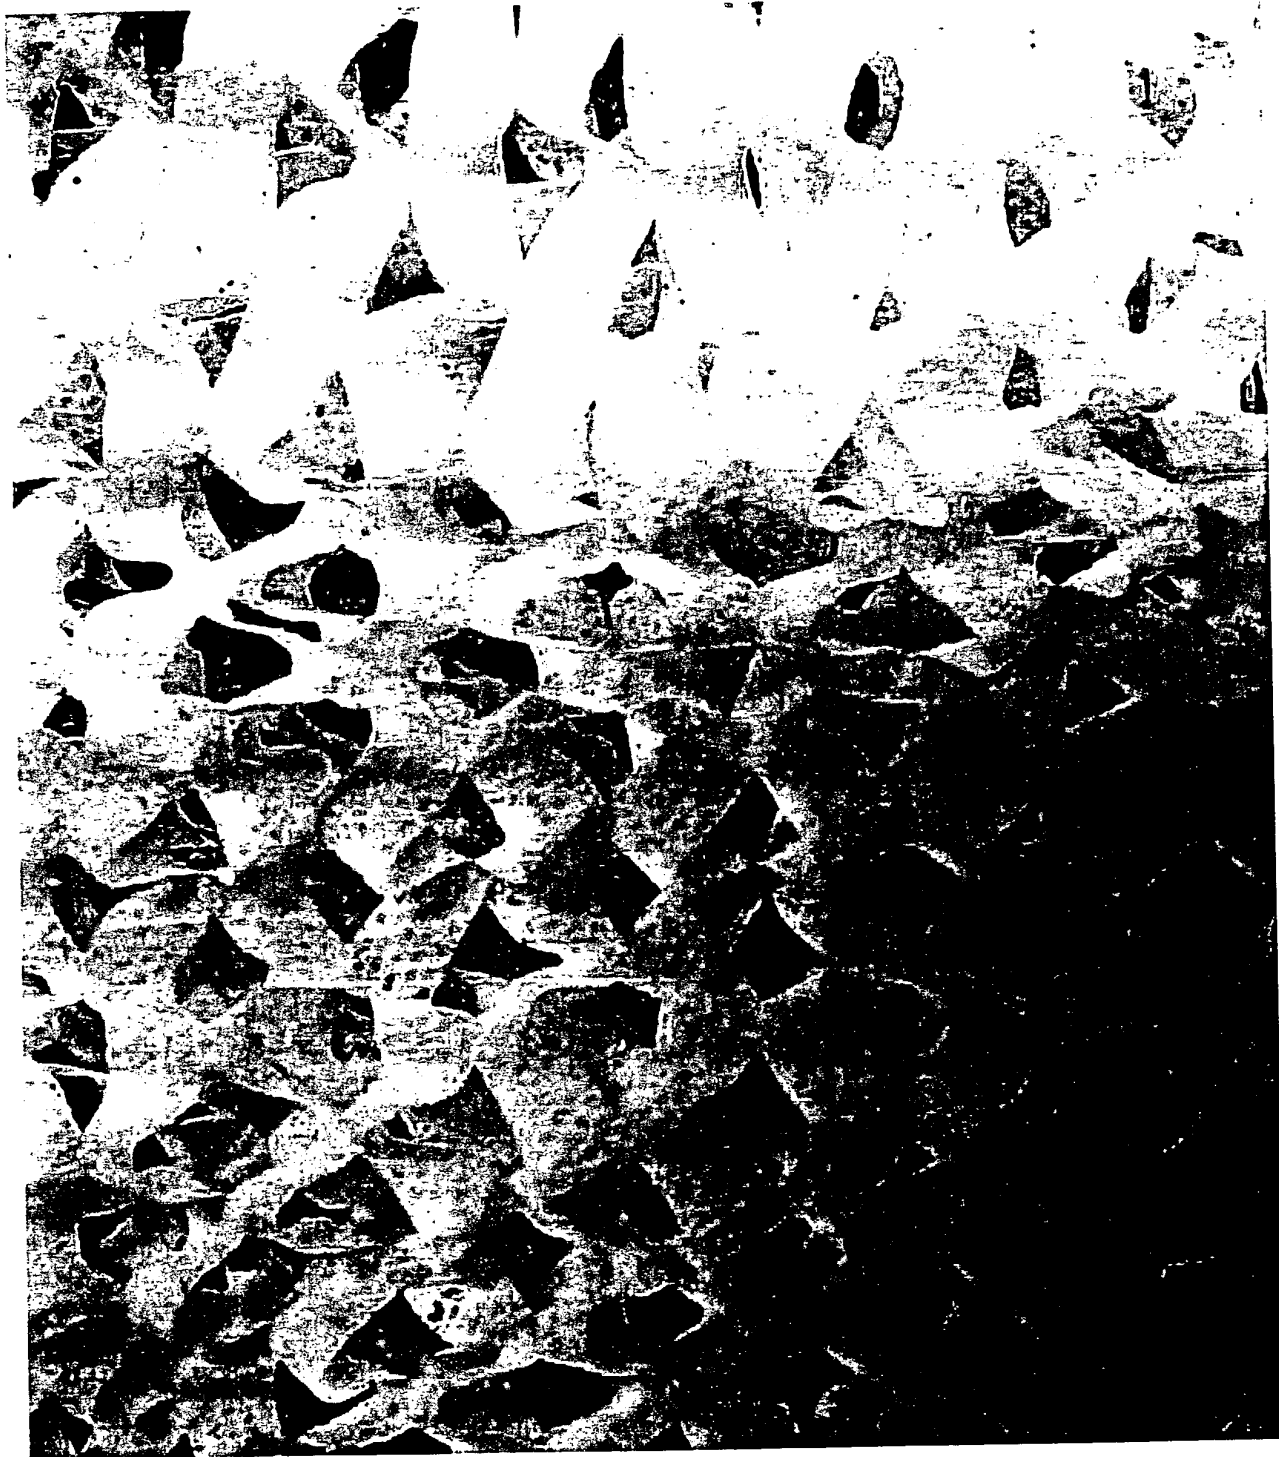


48

42

44

00715354 44700

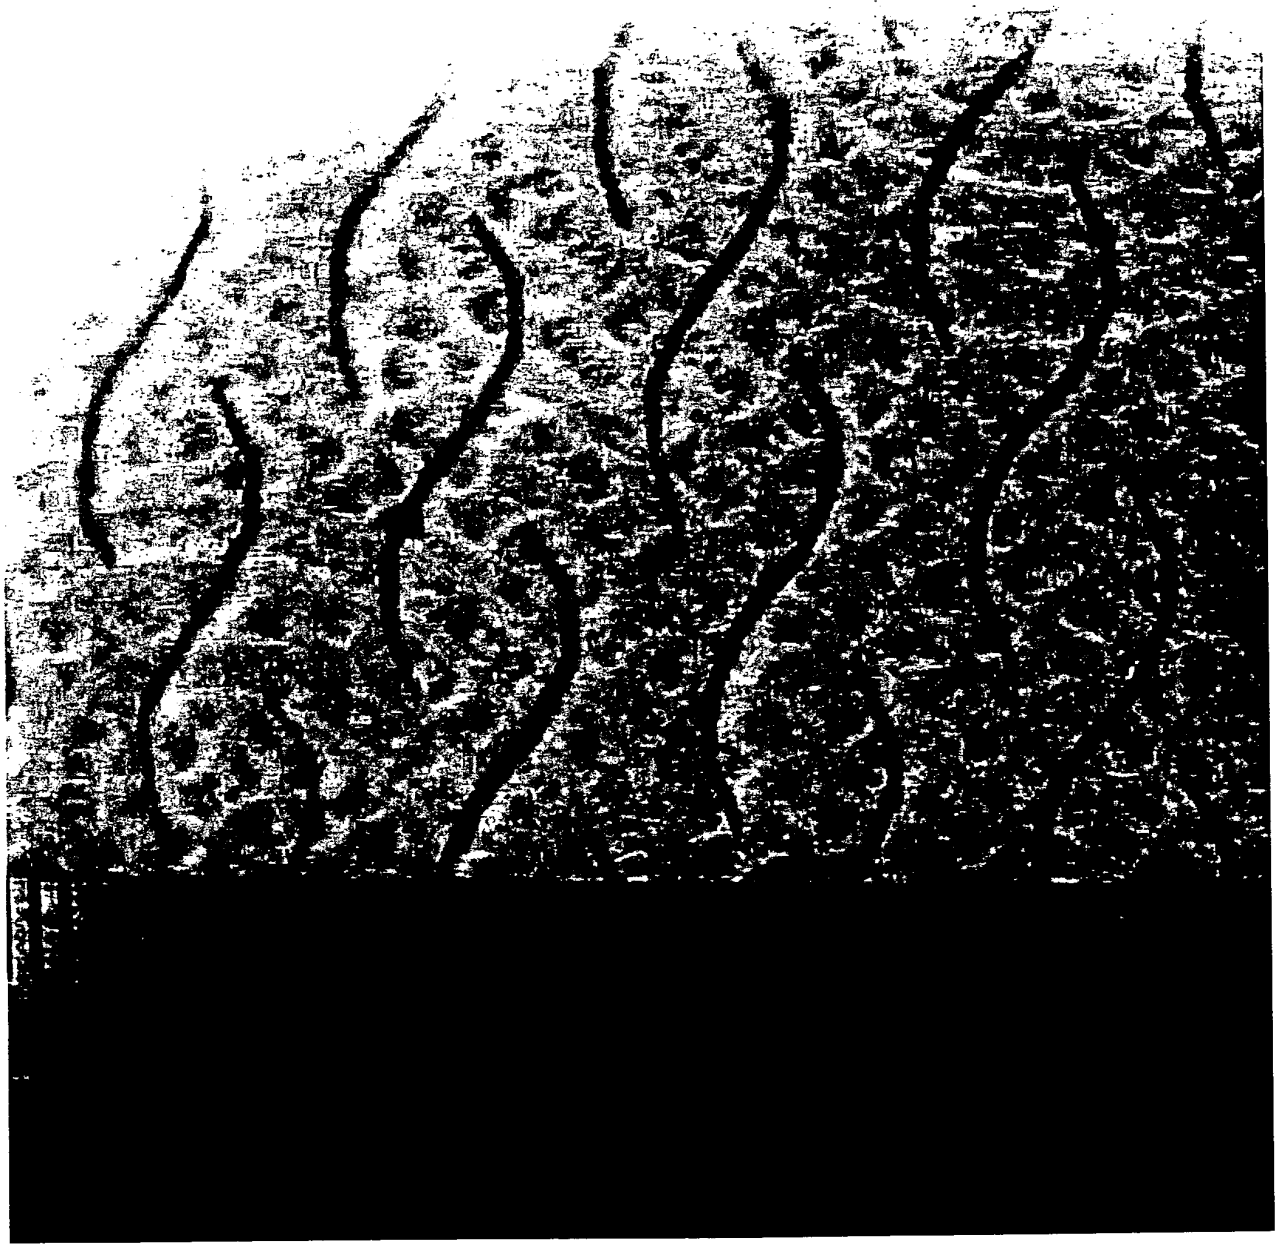

↑ Centimeter Ruler

-10-

00745354.44700

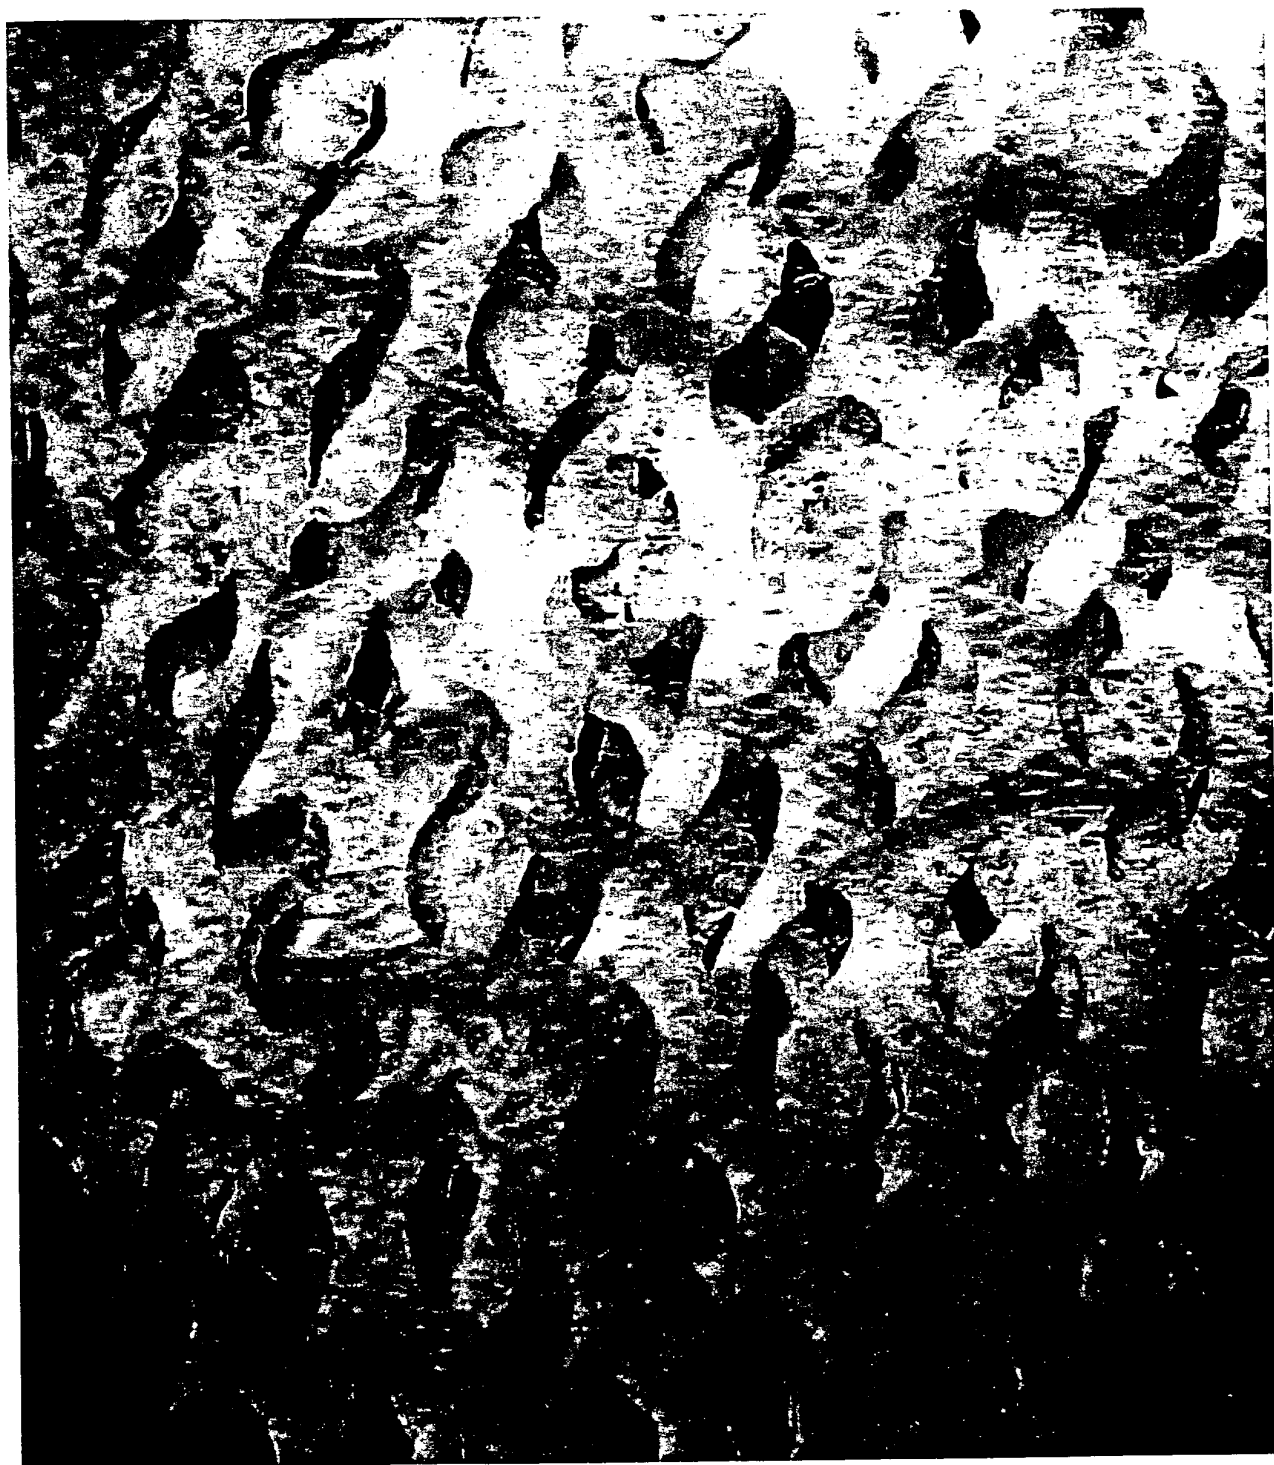



Fig. 11

42

44

48

002TTT"4SEST260

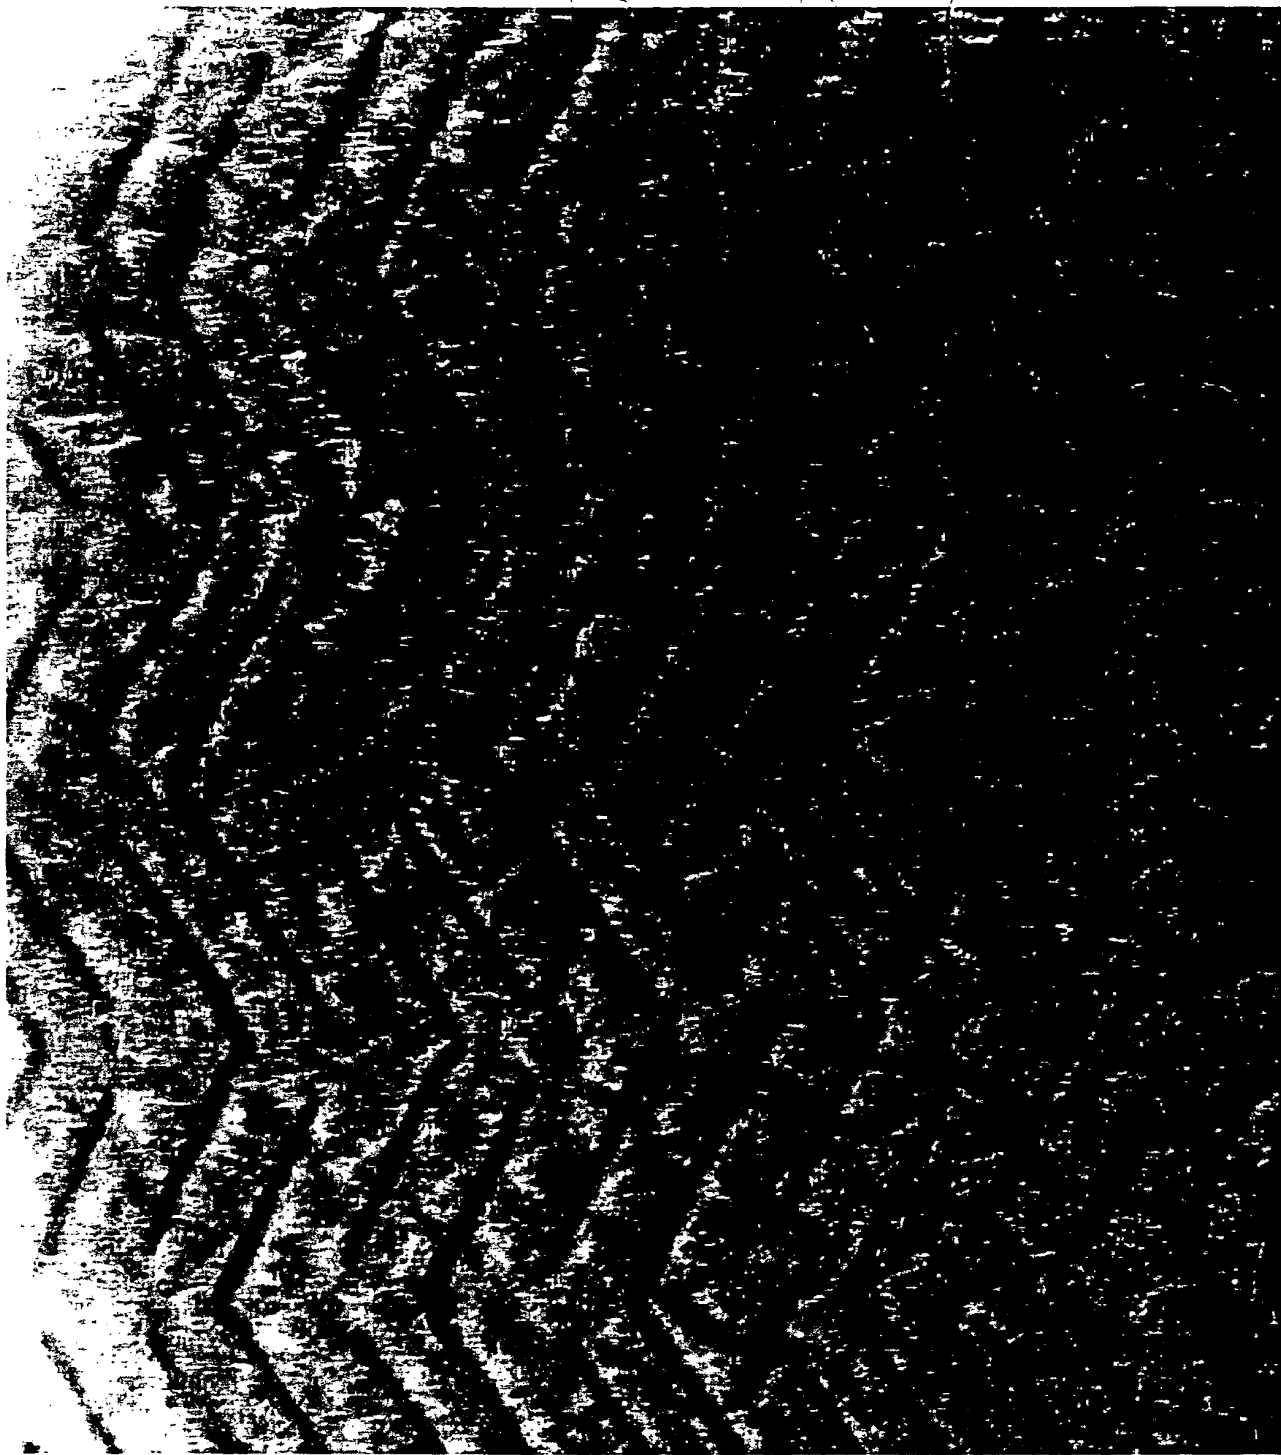

40

Fig. 12

09715354-11700



Figure 13A Example 1 with Prior Art

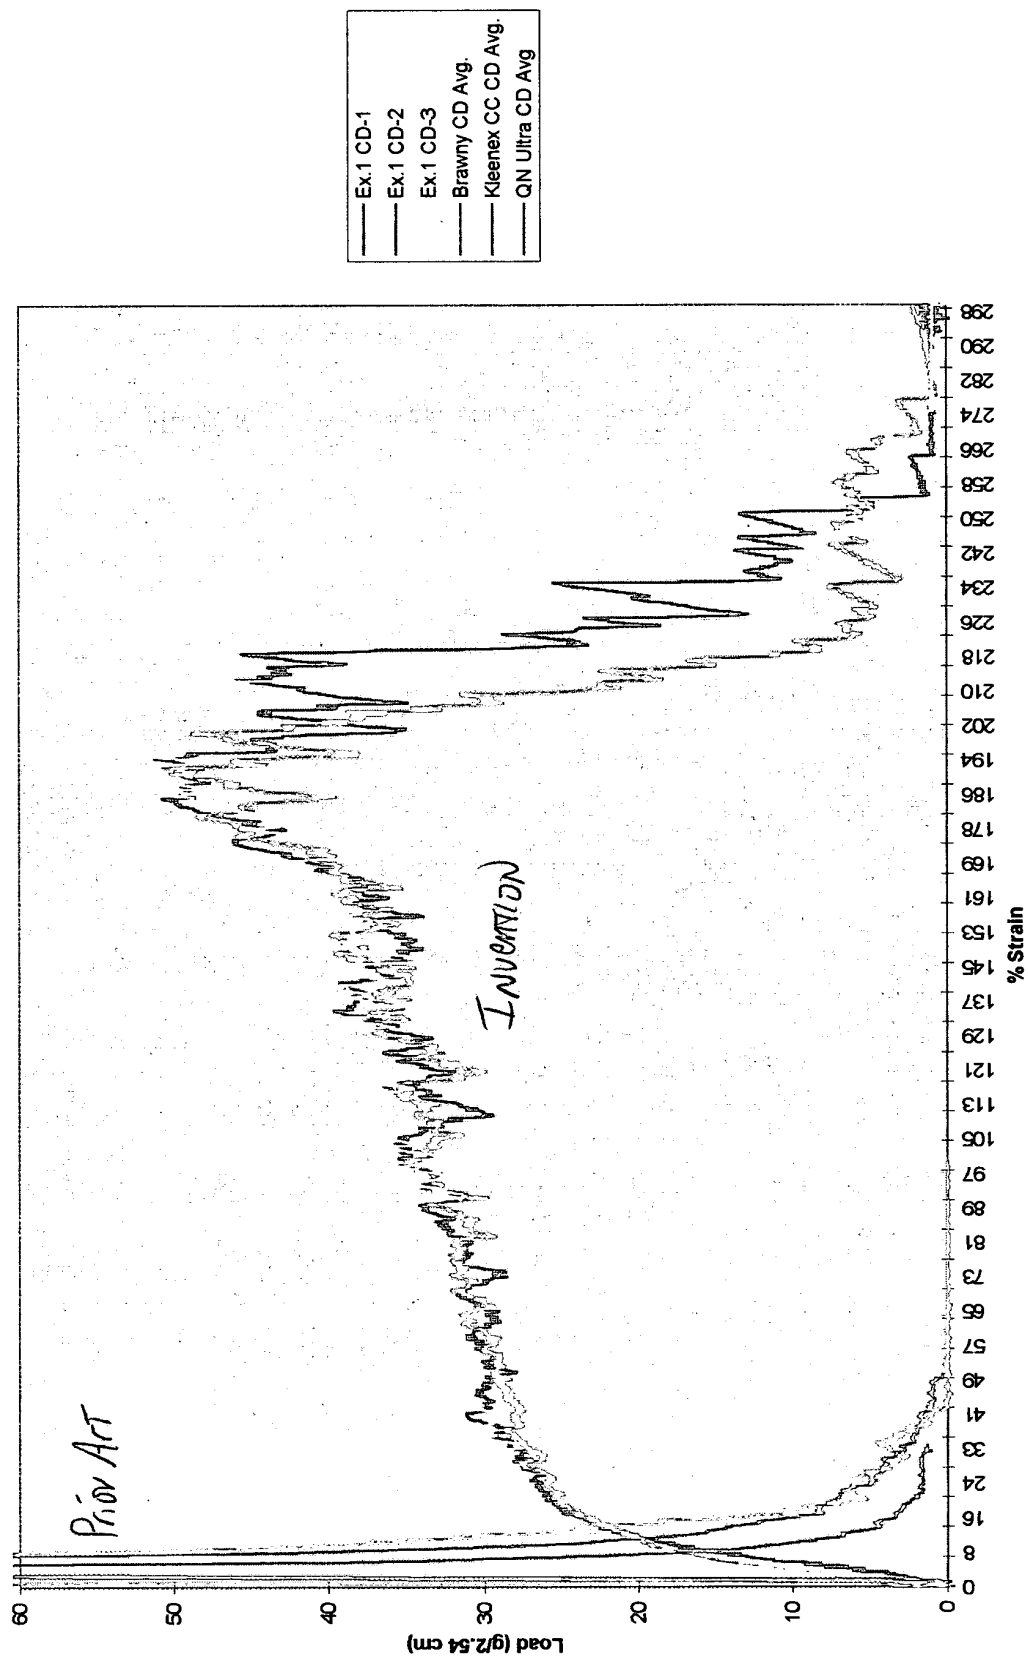


Figure 14. Example 2

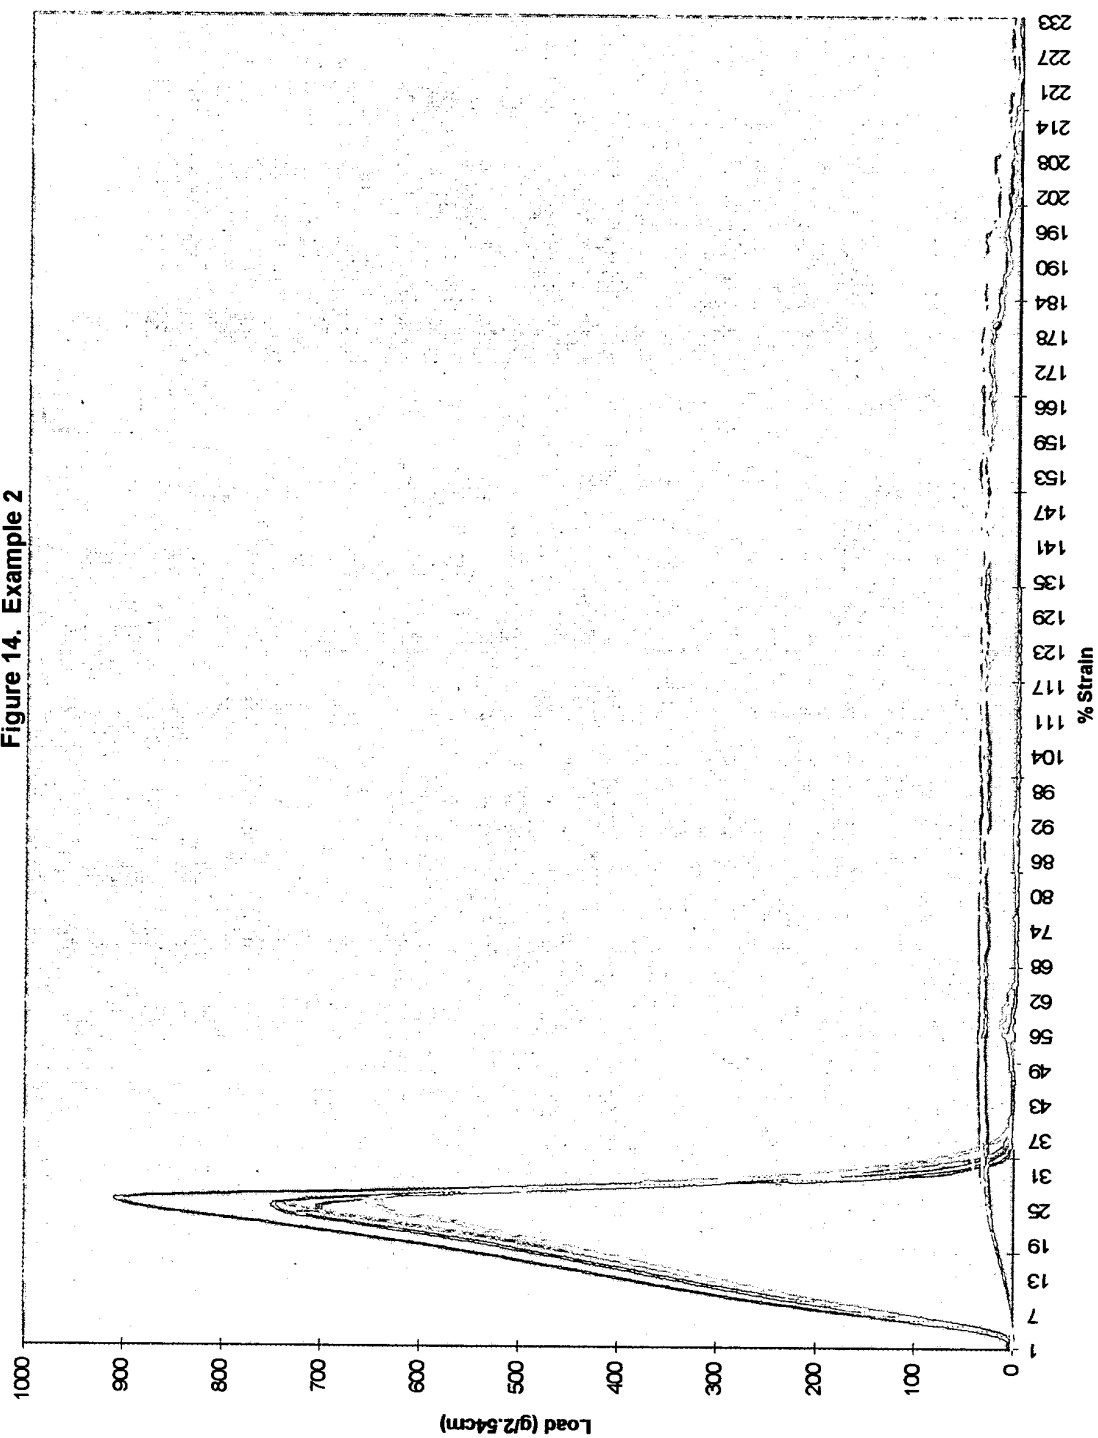


Figure 15. Example 3

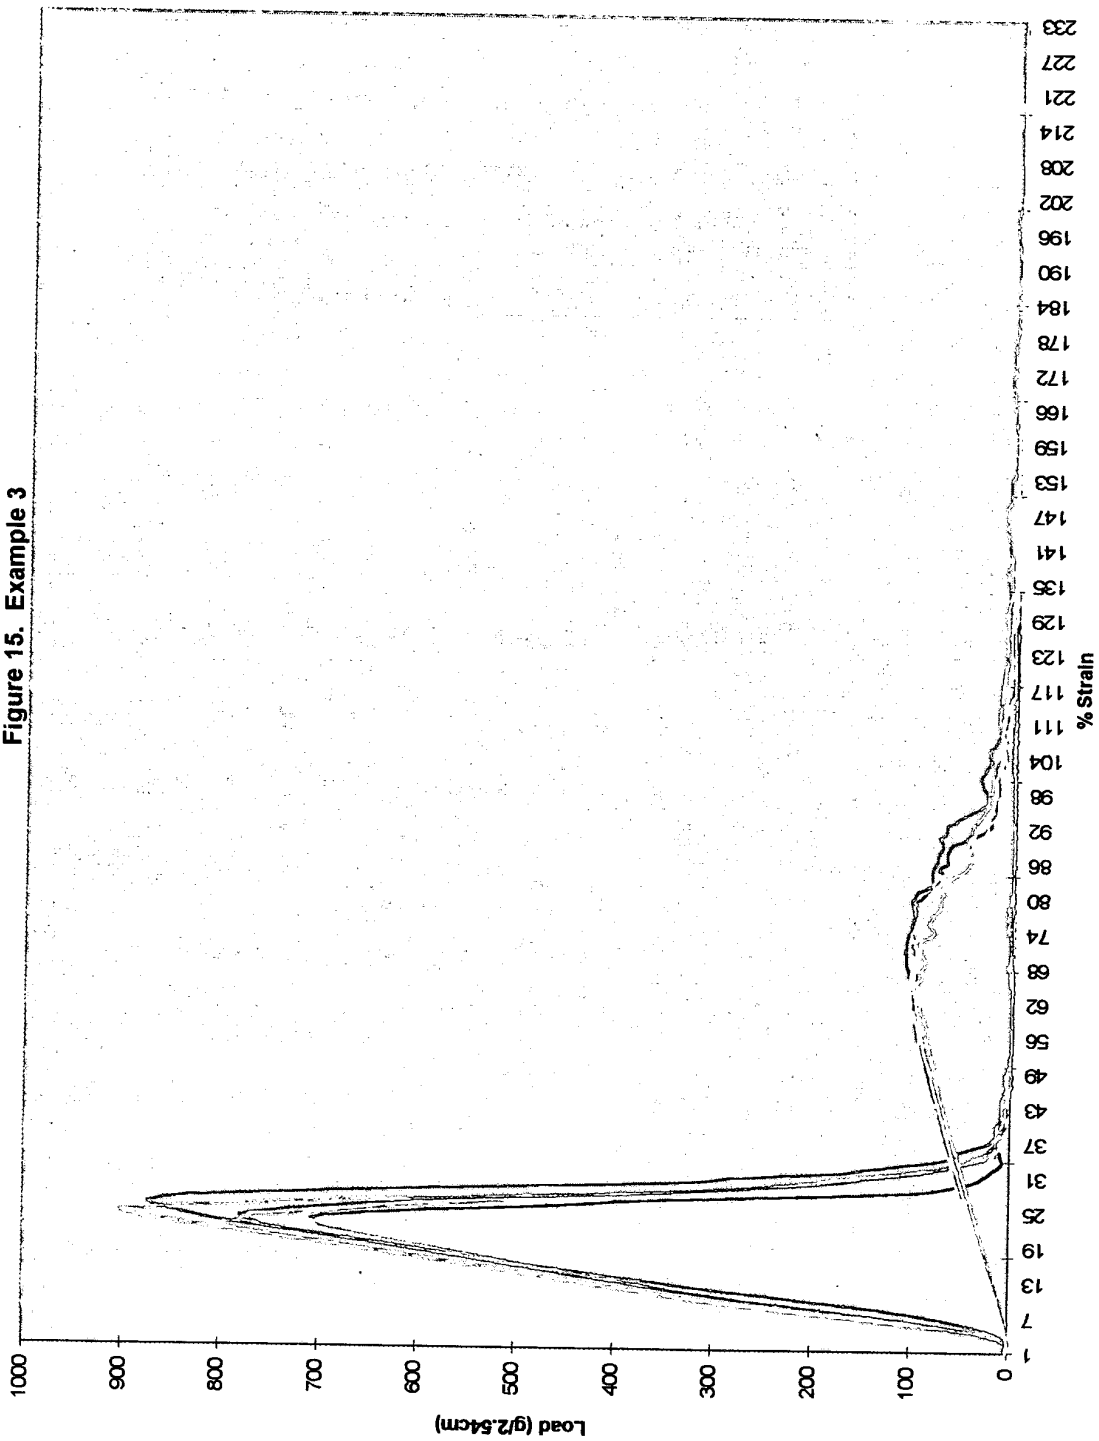


Figure 16. Example 4



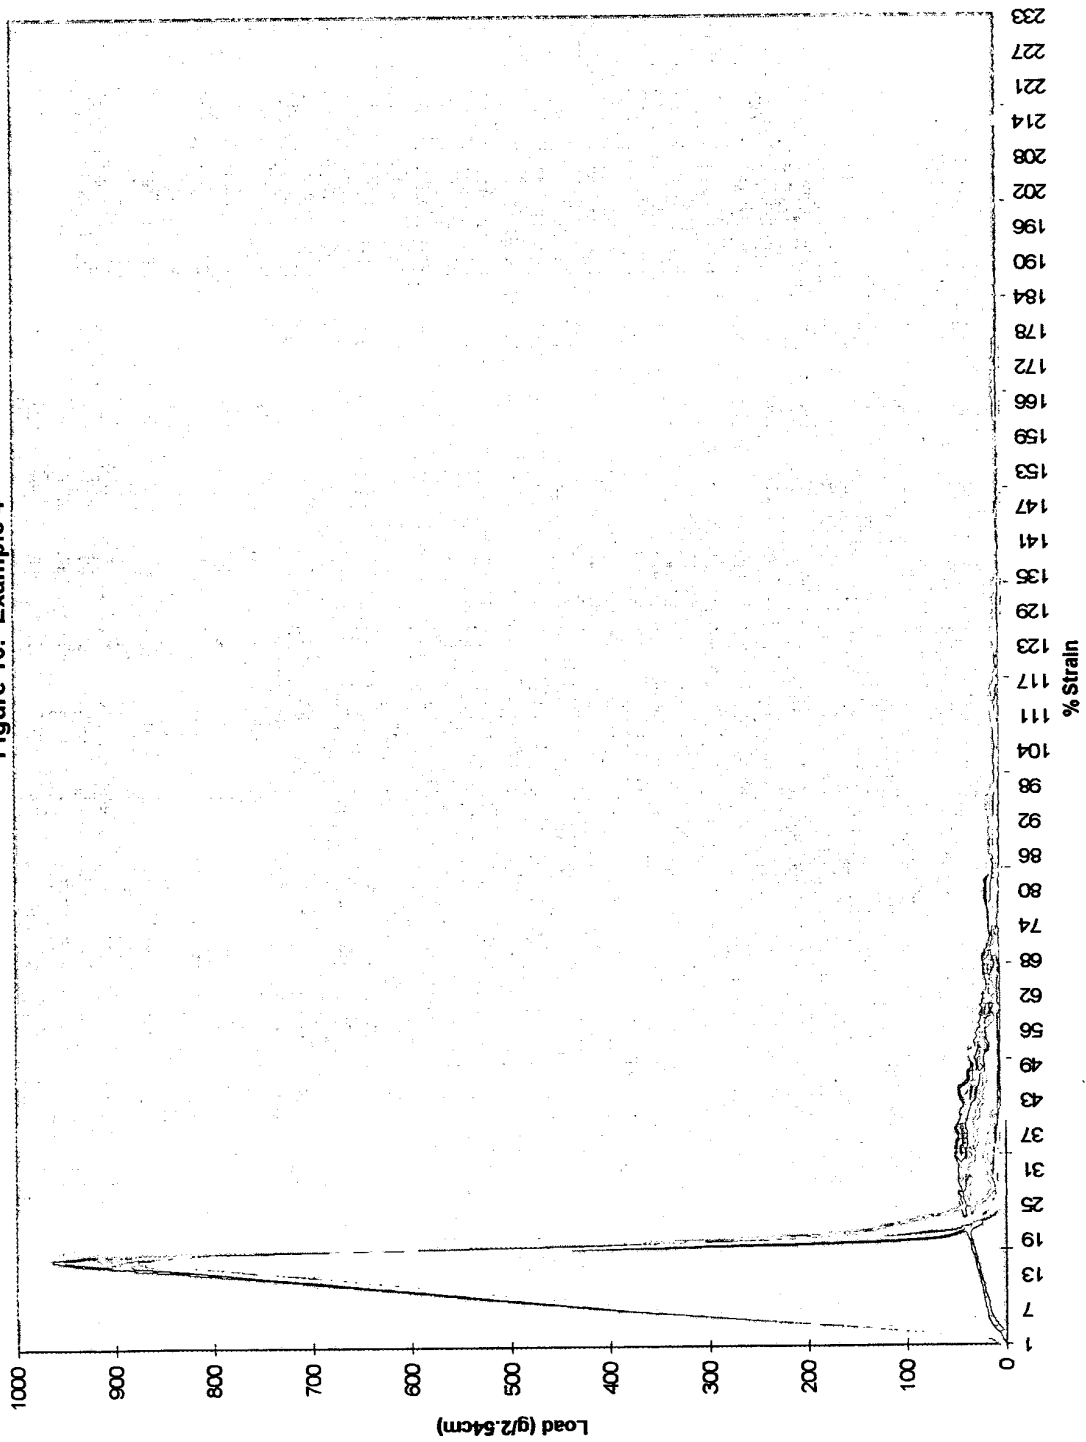


Figure 17. Example 5

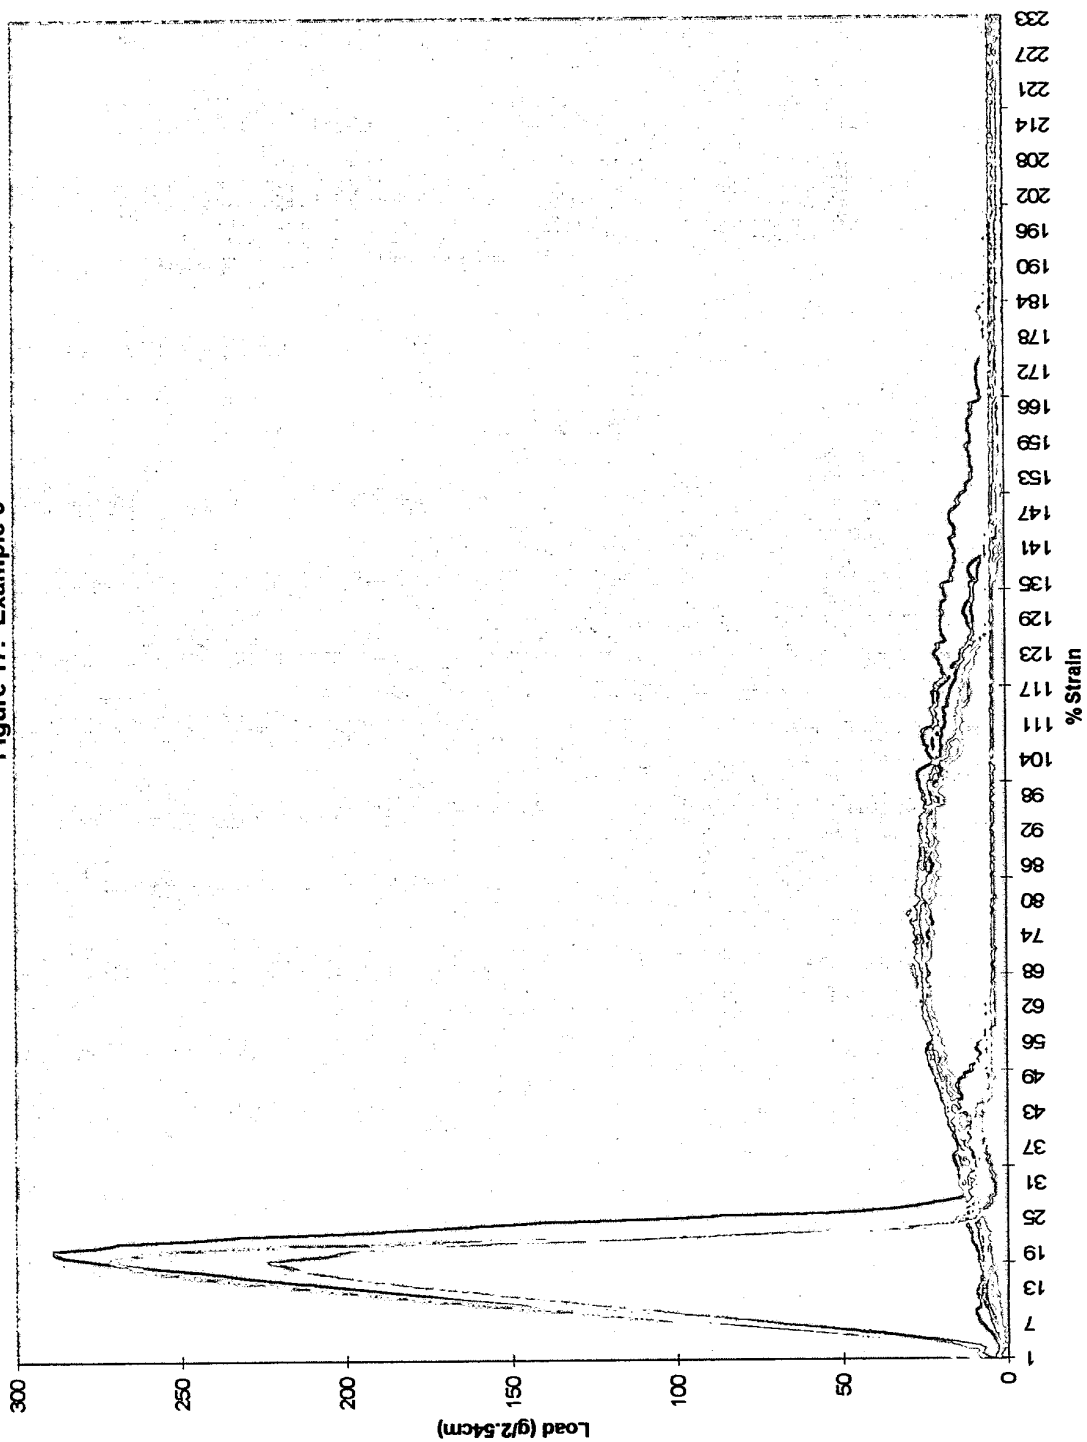

- Ex 5 CD-1
- Ex 5 CD-2
- Ex 5 CD-3
- Ex 5 CD-4
- Ex 5 CD-5
- Ex 5 CD Avg.
- Ex 5 MD-1
- Ex 5 MD-2
- Ex 5 MD-3
- Ex 5 MD-4
- Ex 5 MD-5
- Ex 5 MD Avg.

Figure 18. Example 6

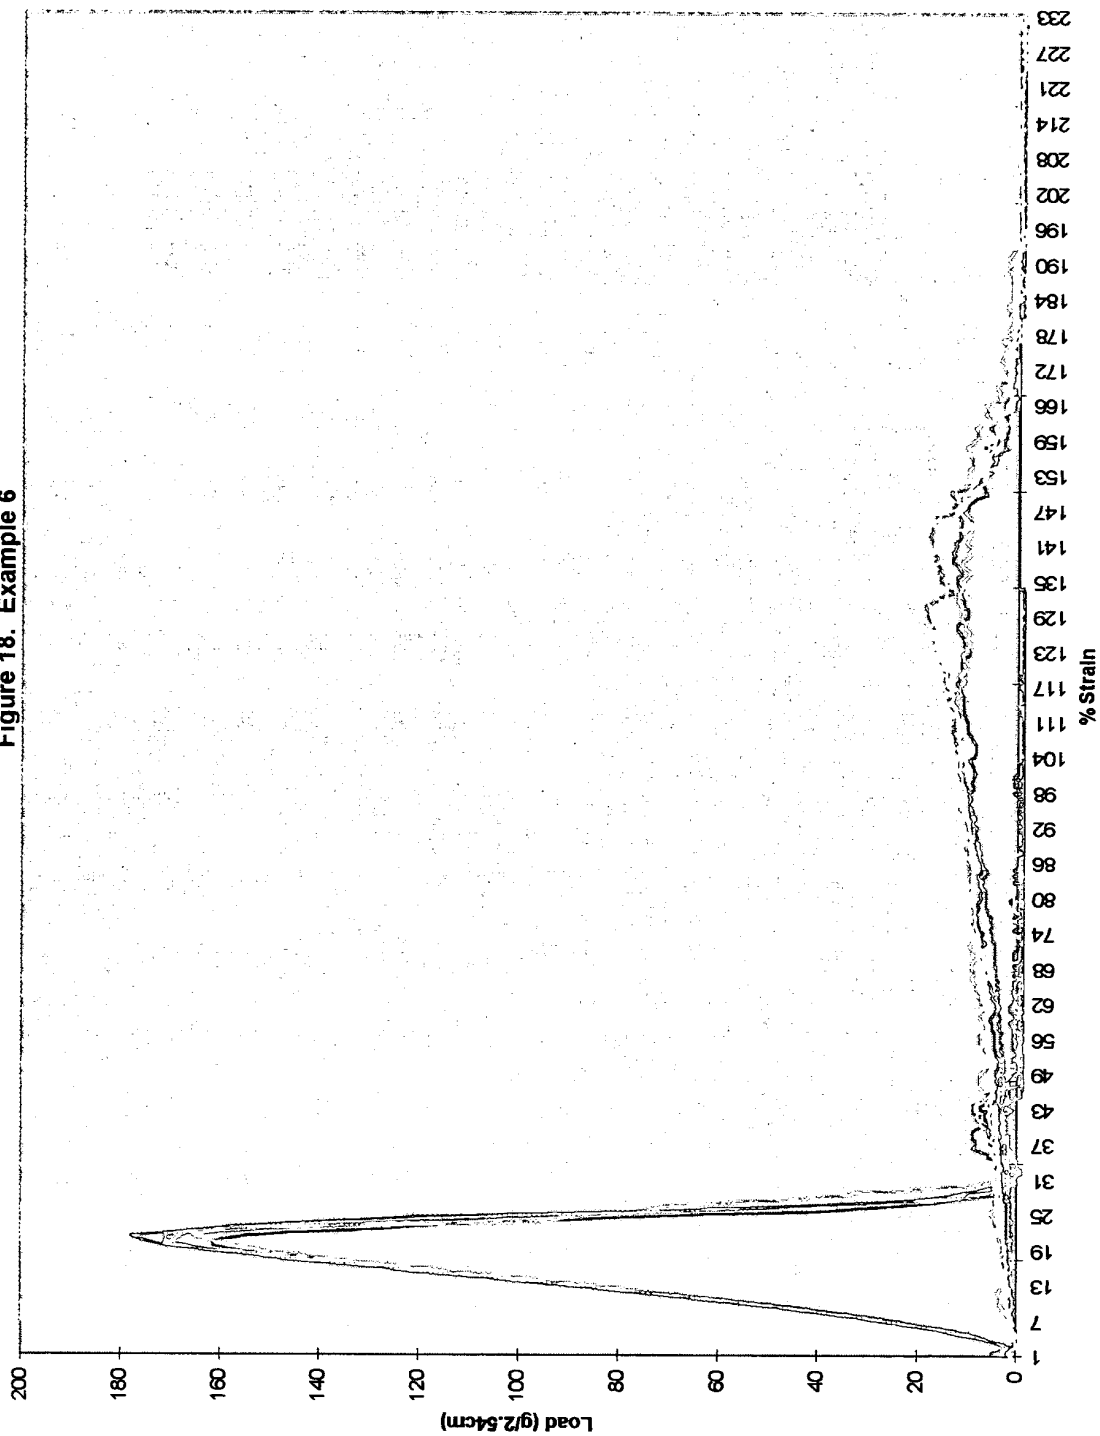

COLETT TEST 60

Fig. Example 1


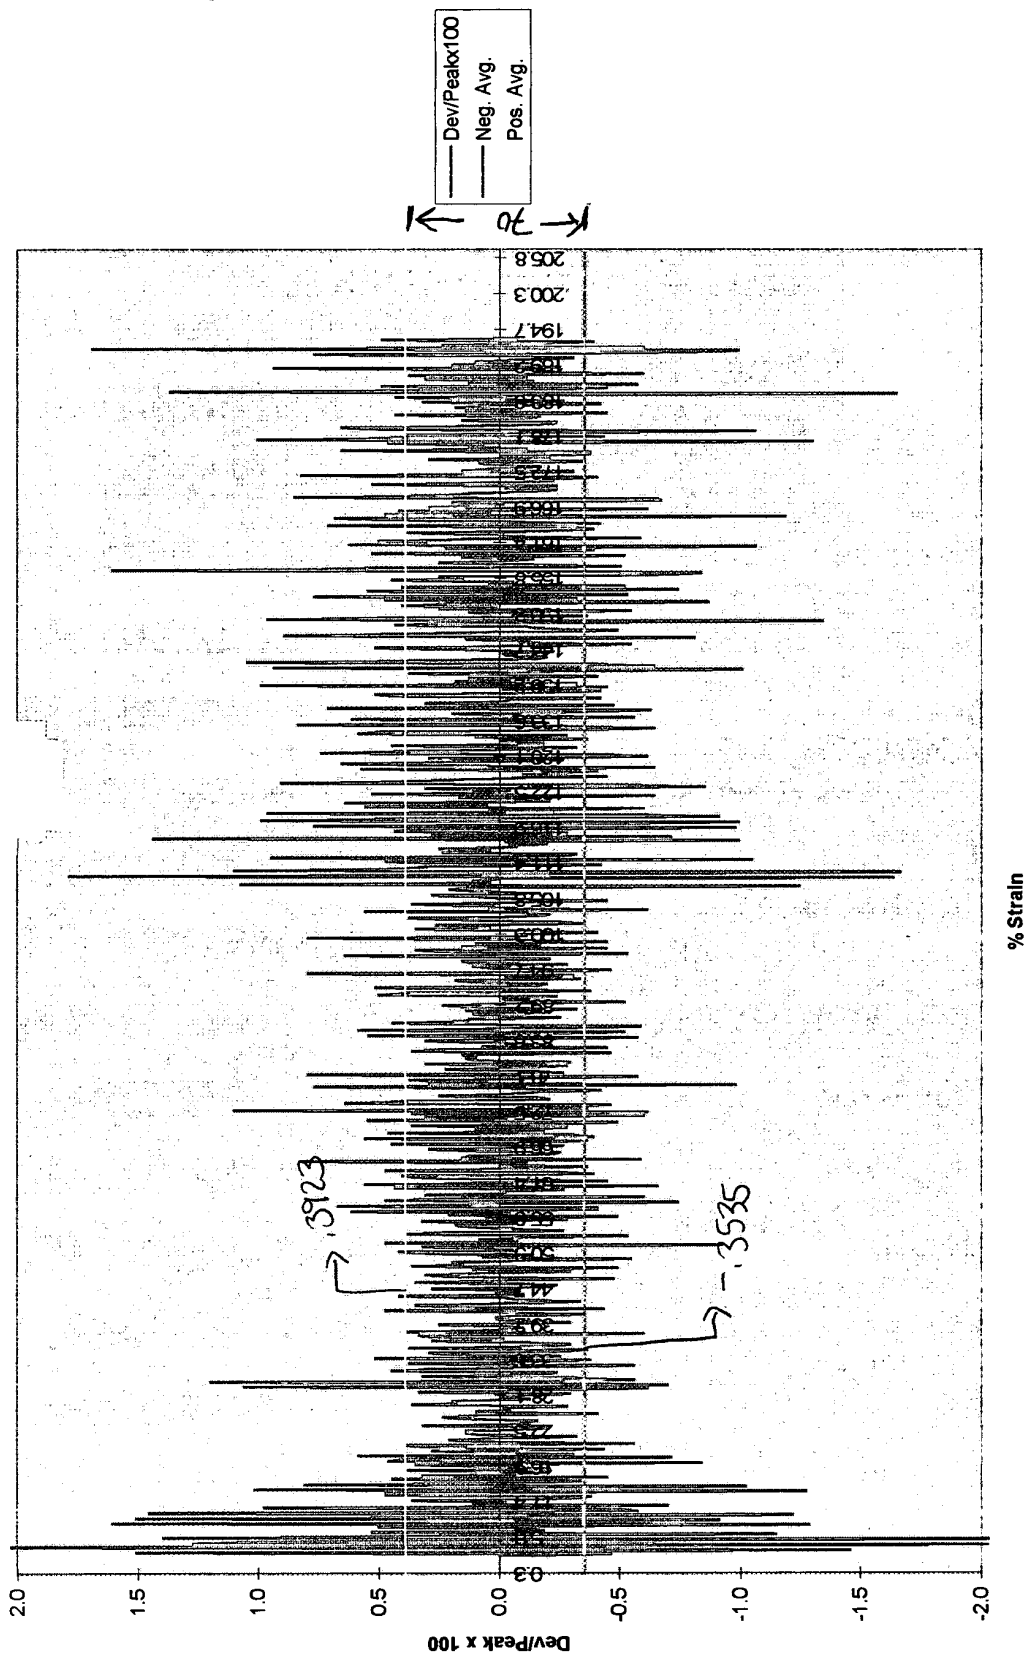


Fig20. Example 2

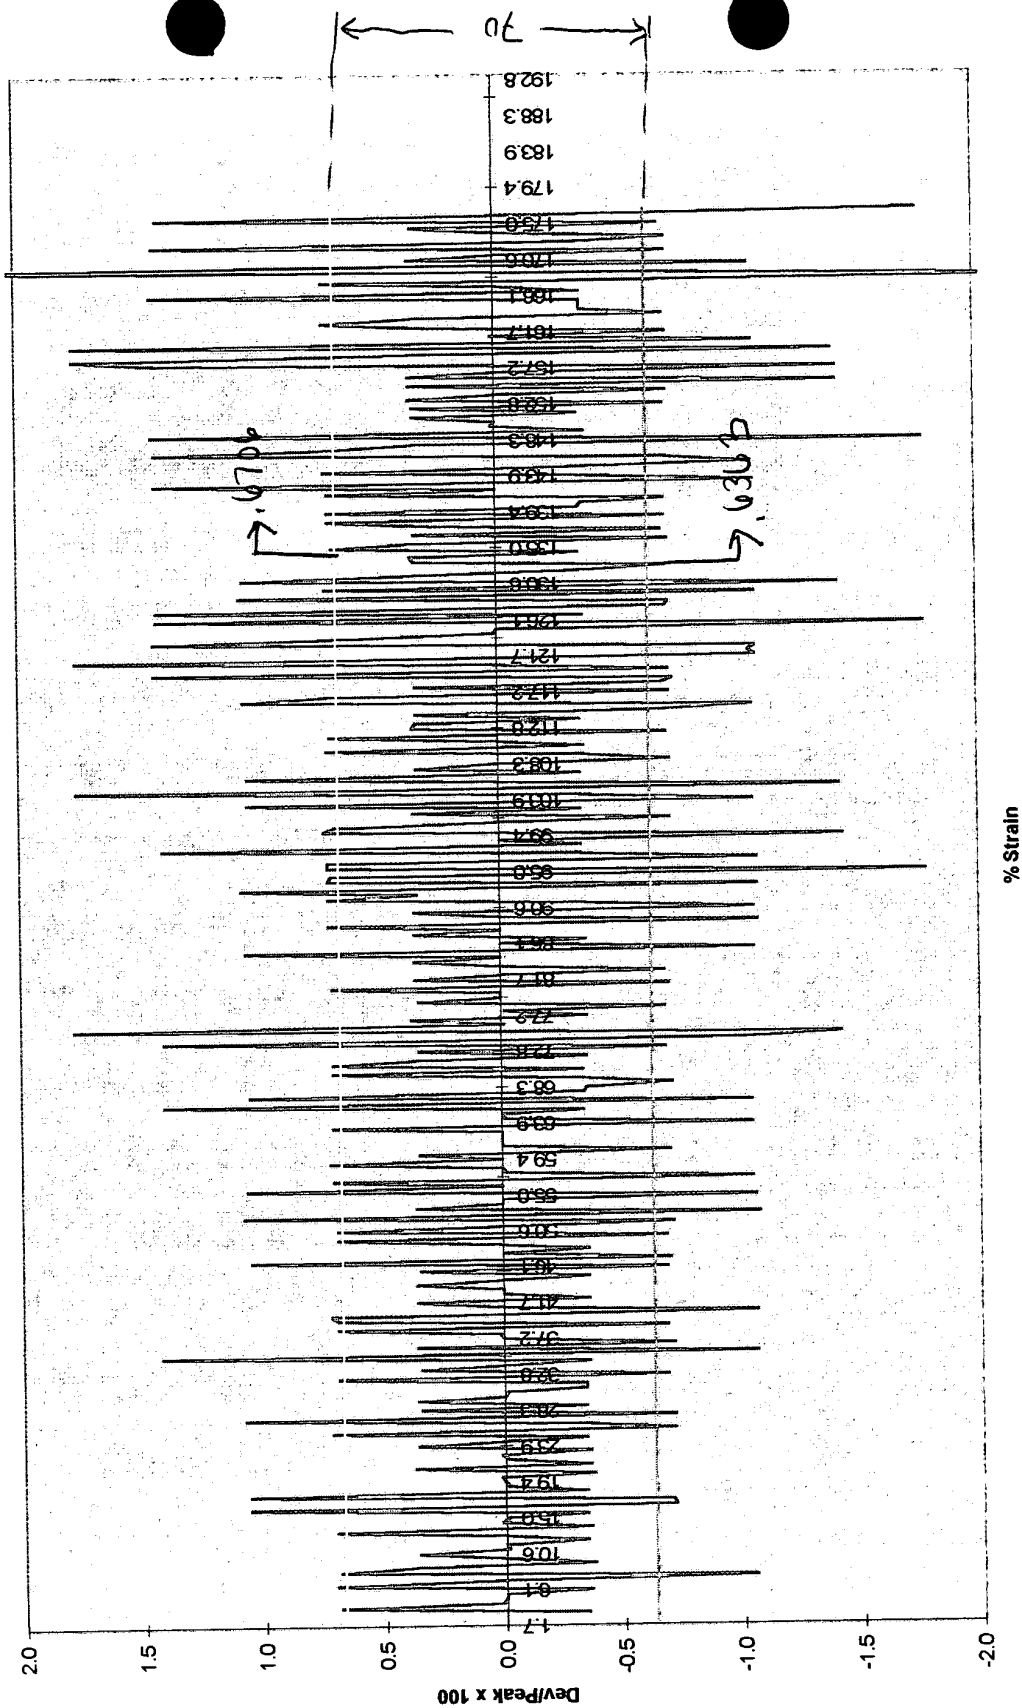

004TF "HESIT 260

Fig 21 Example 3

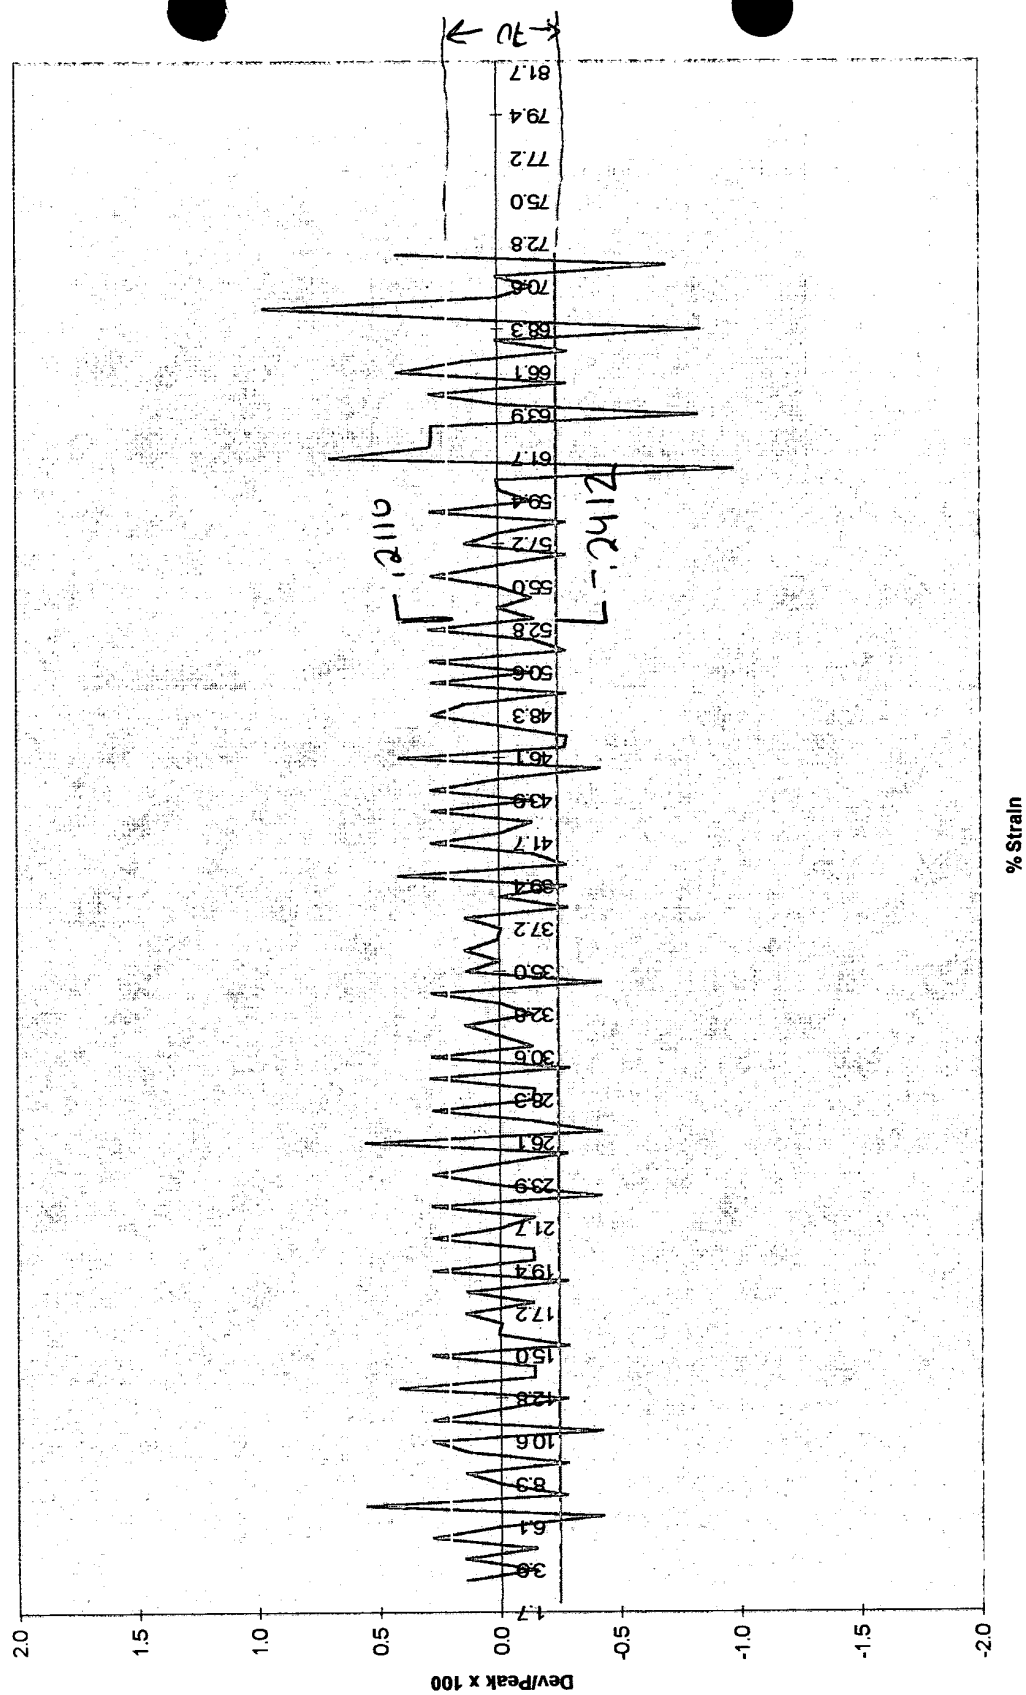


Fig. 22 Example 4


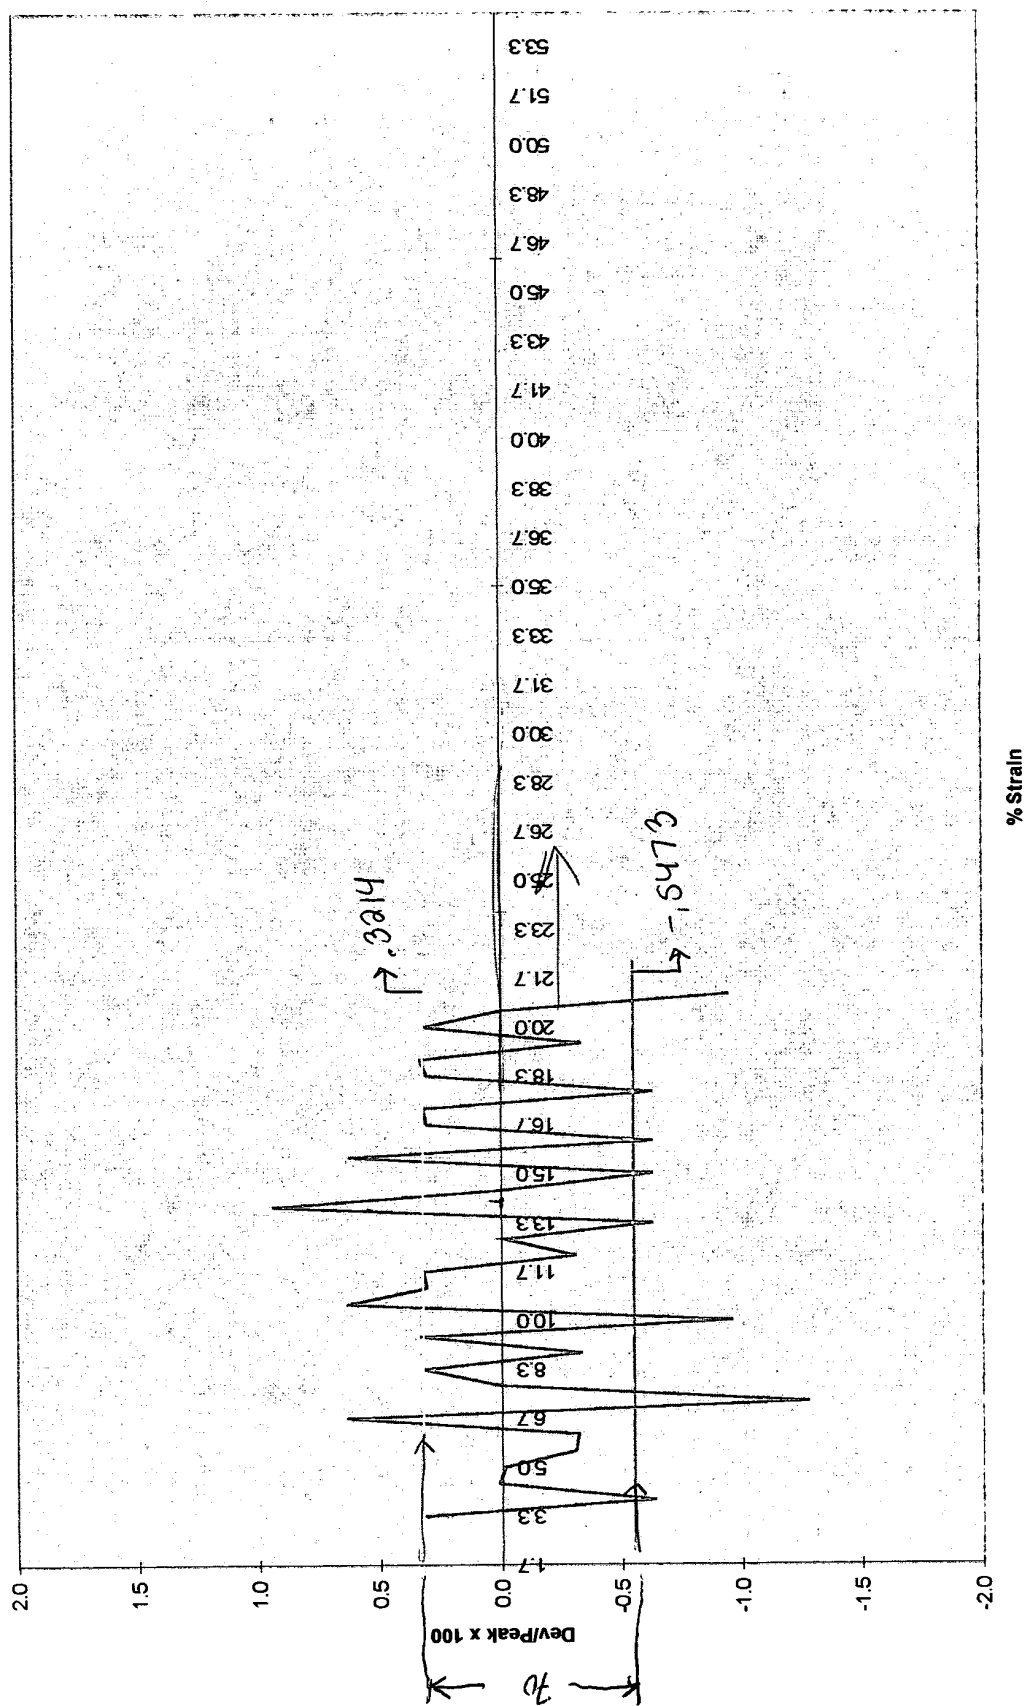


Fig. 23 Example 5

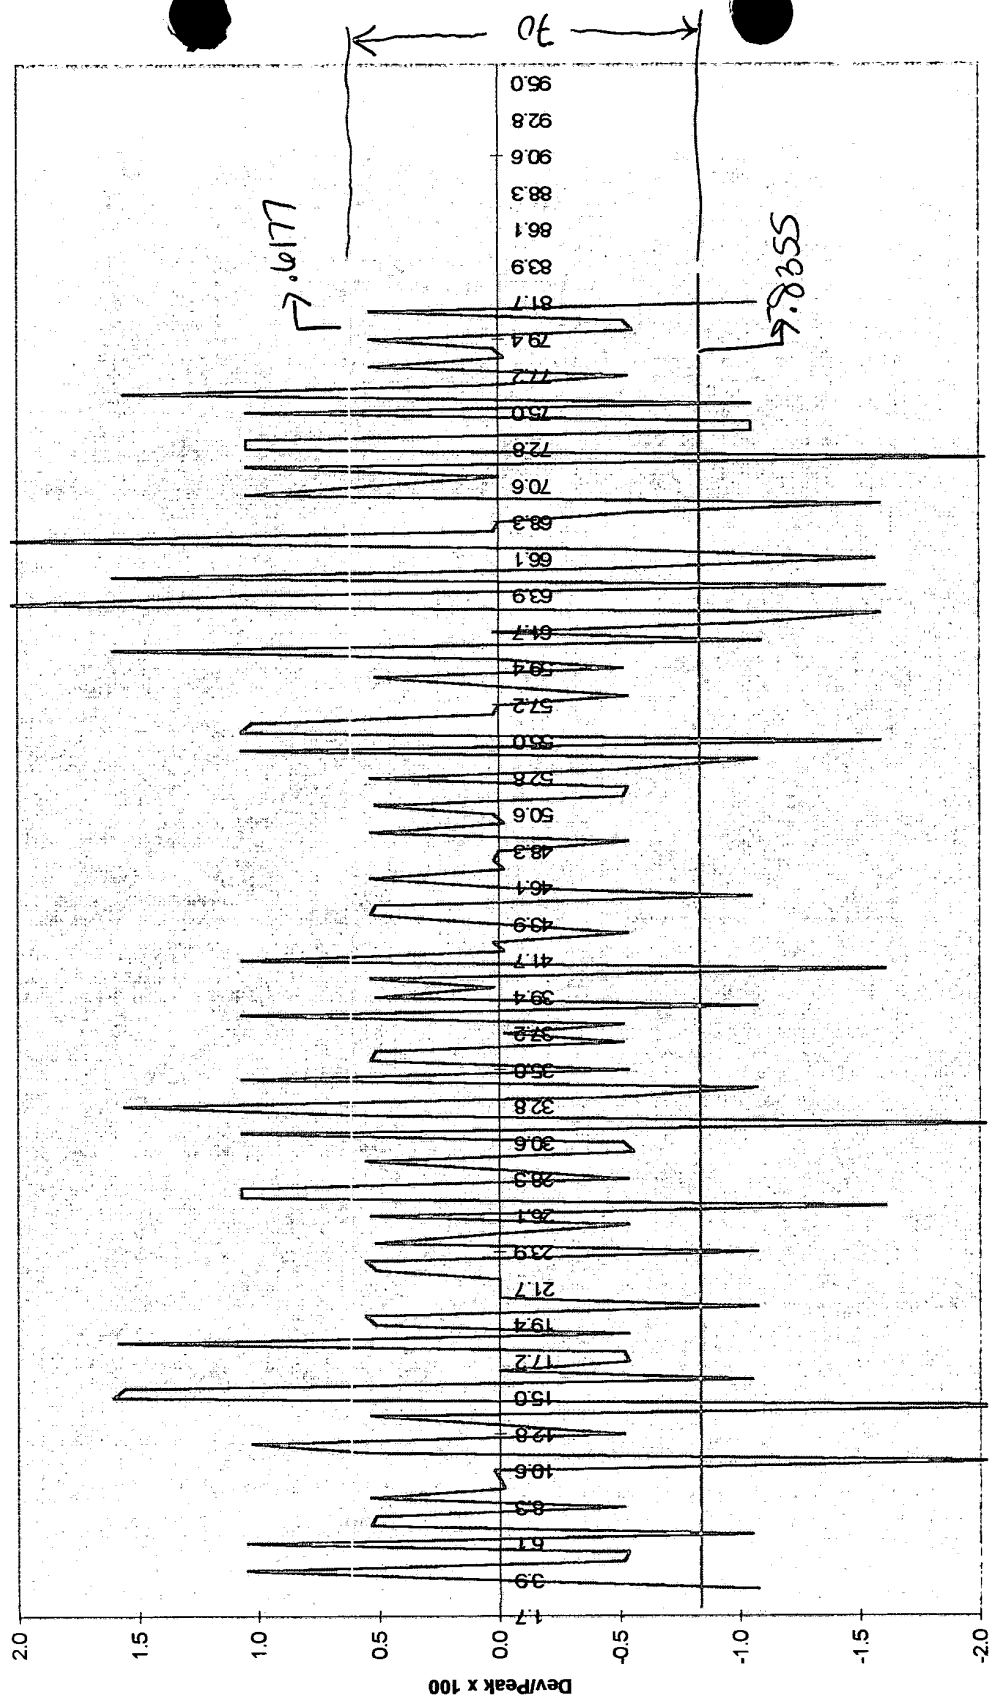

CONFIDENTIAL

Fig. 24 Example 6

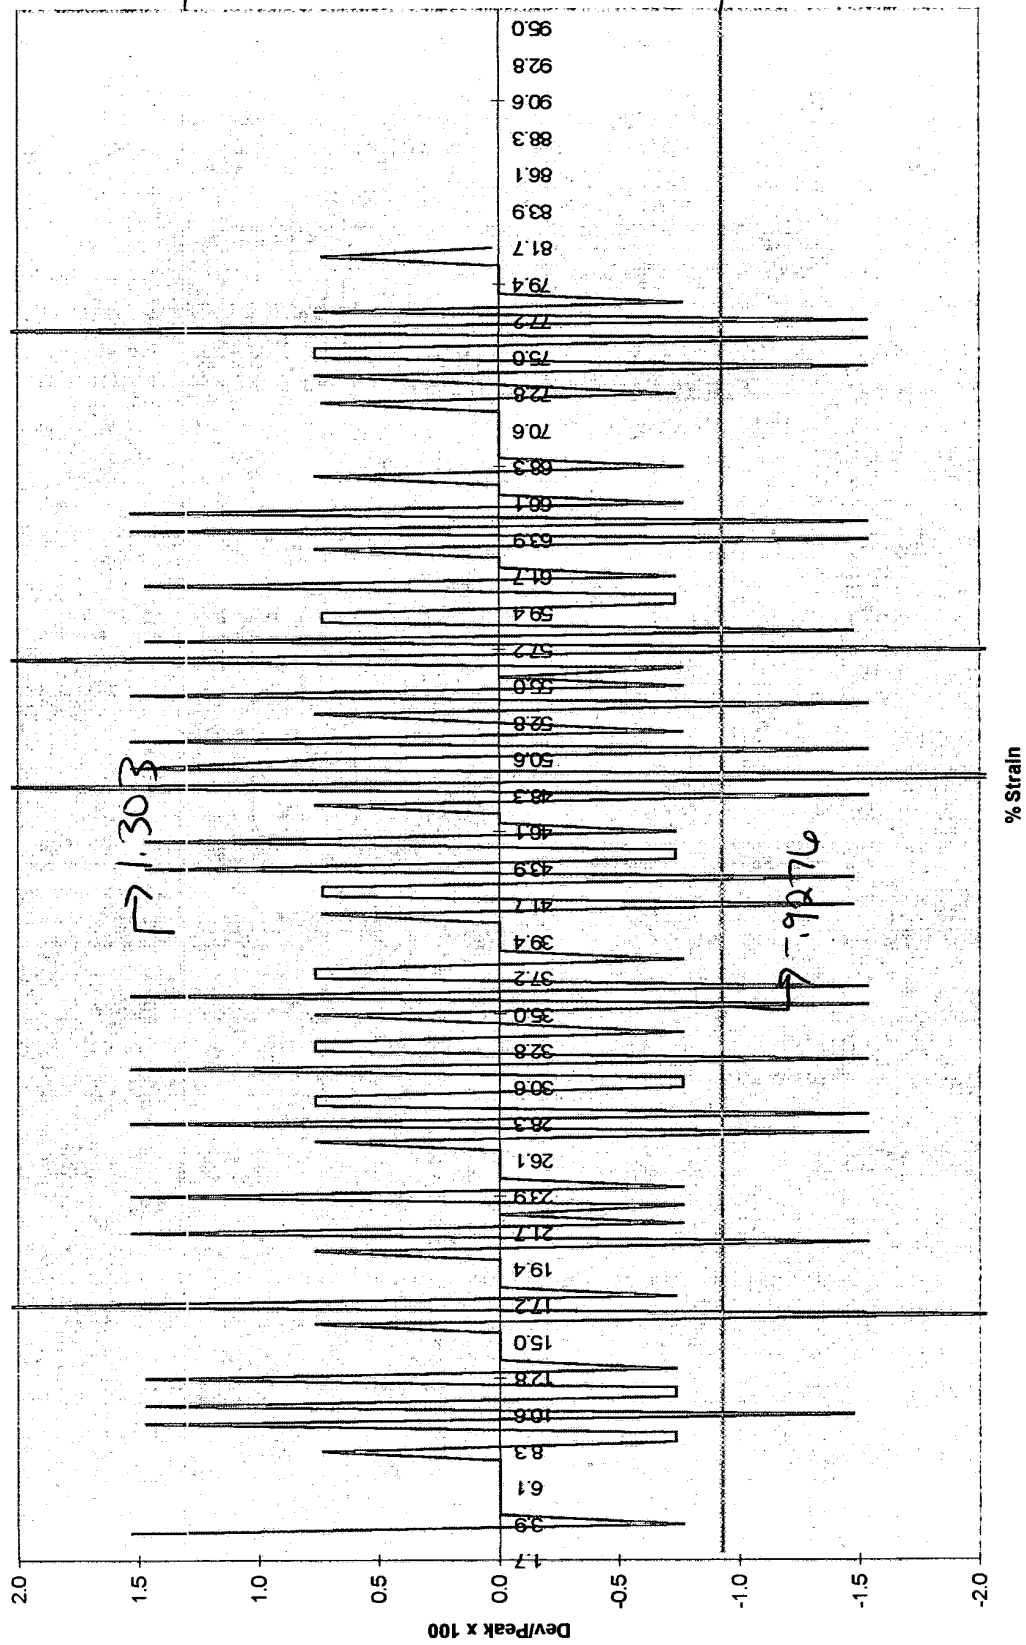


Figure 25


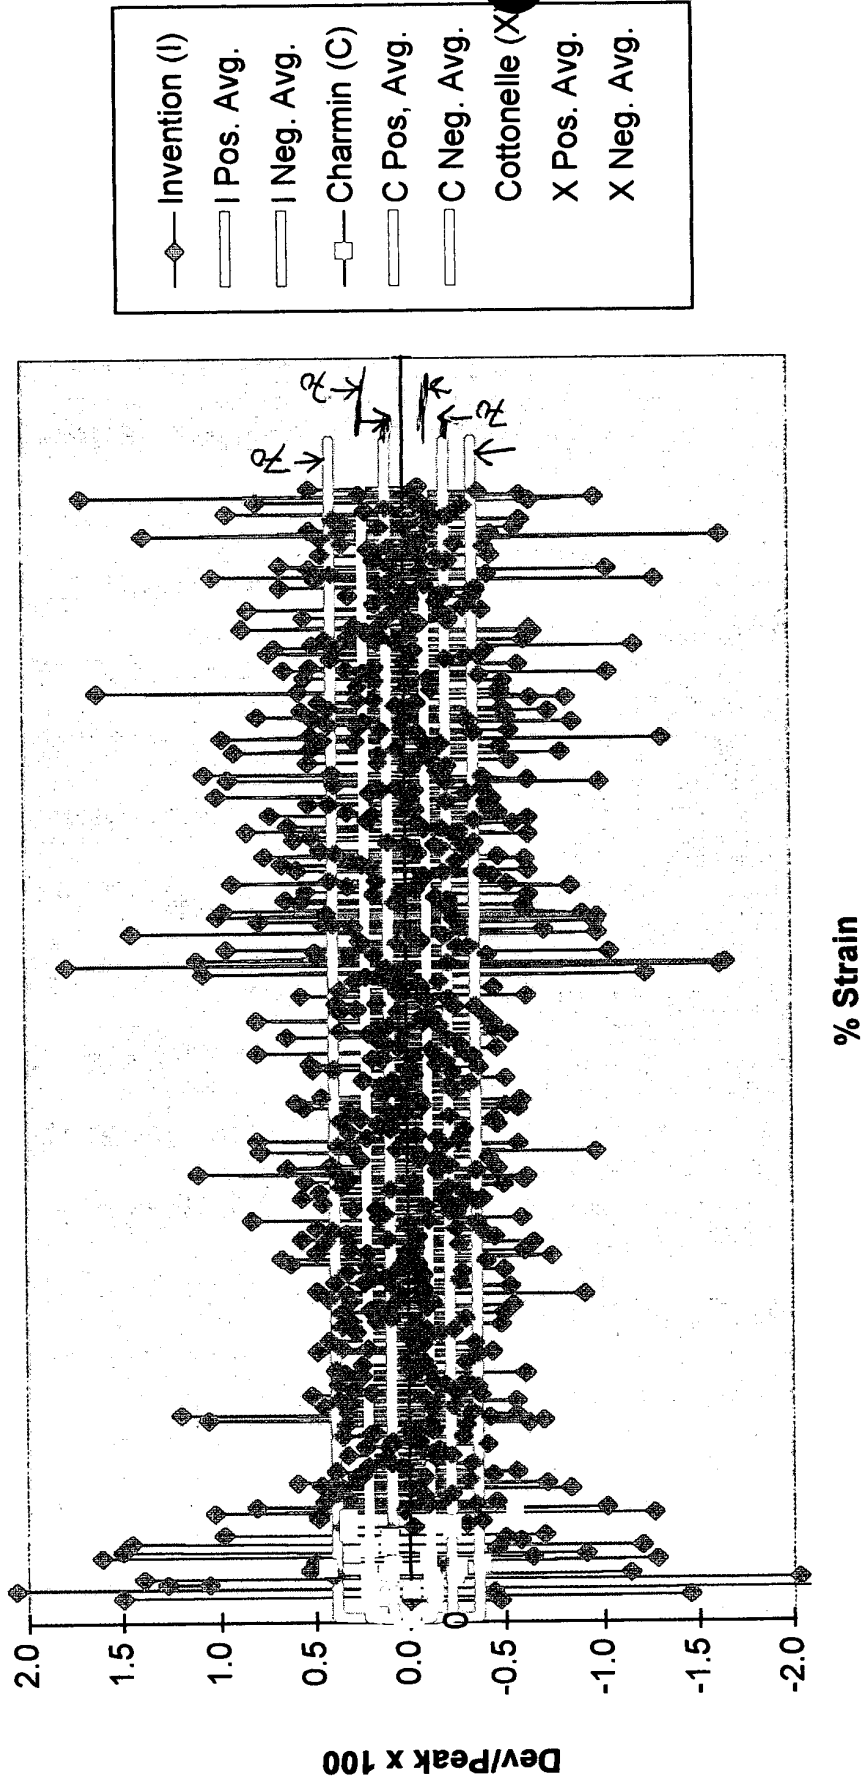


Figure 26

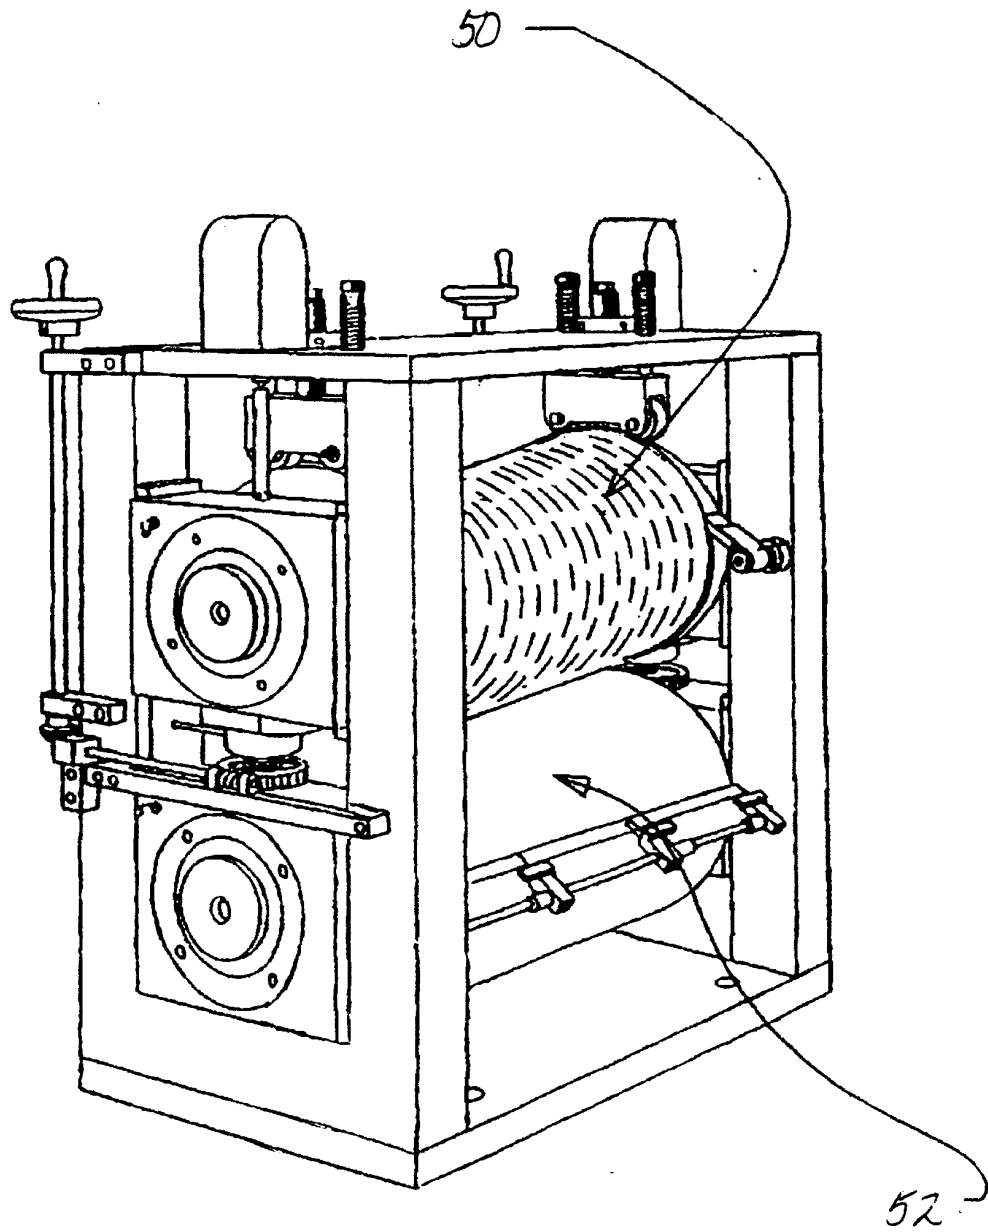

09715354-111700

Figure 27

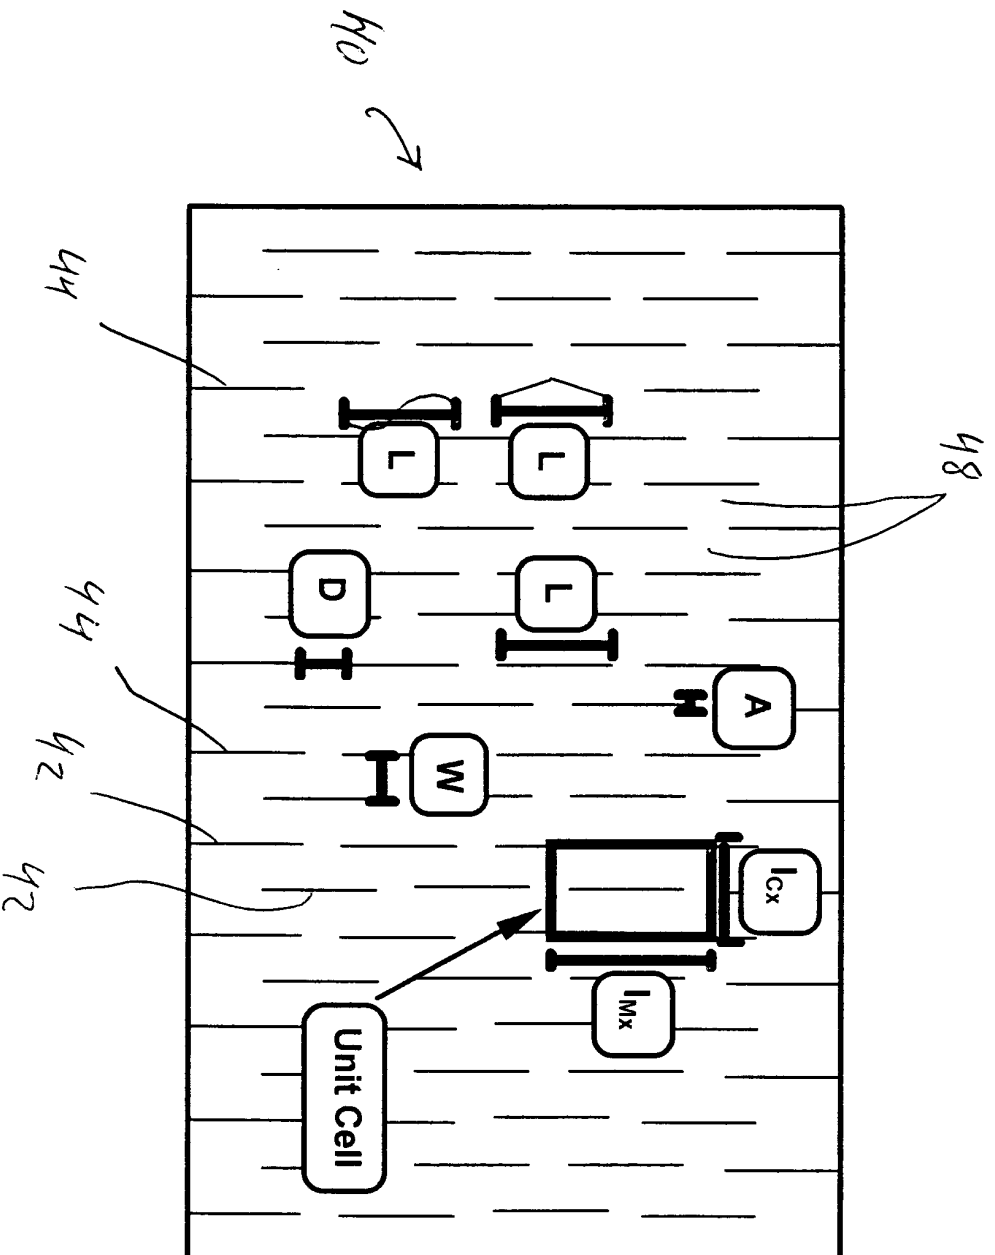


Figure 28

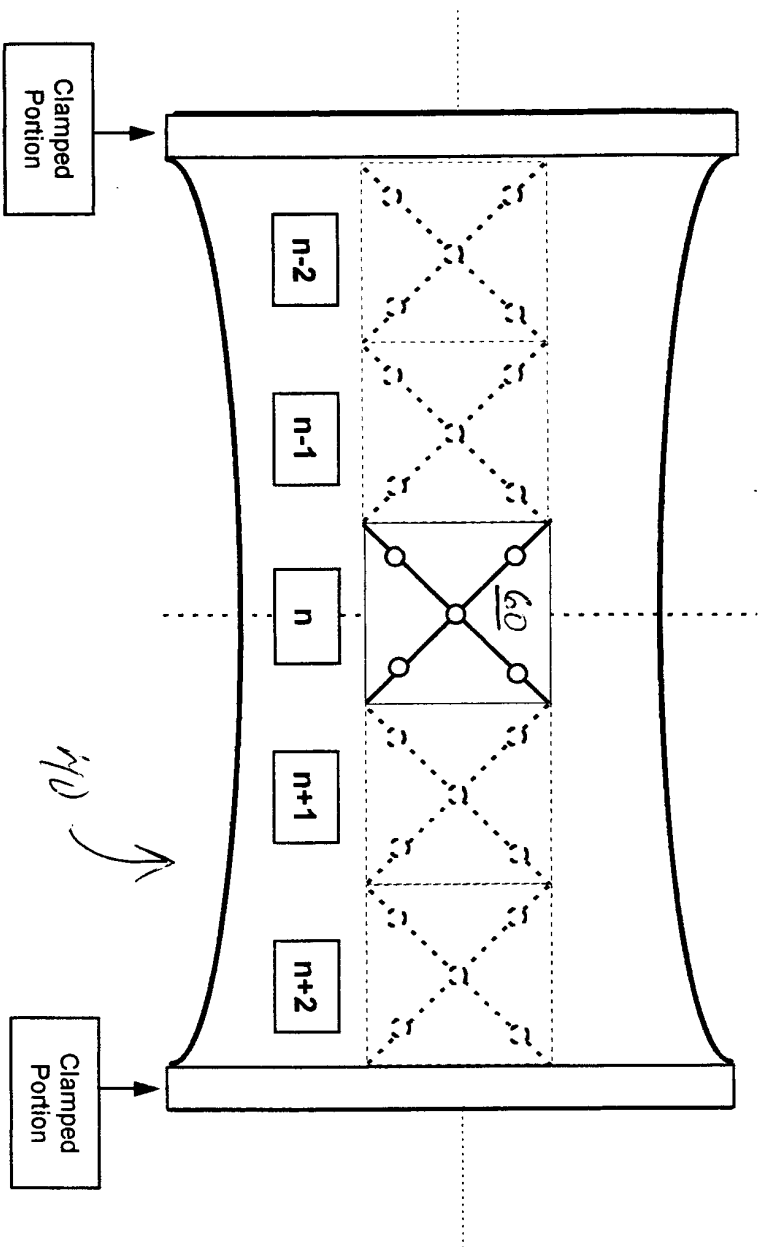


Figure 29a

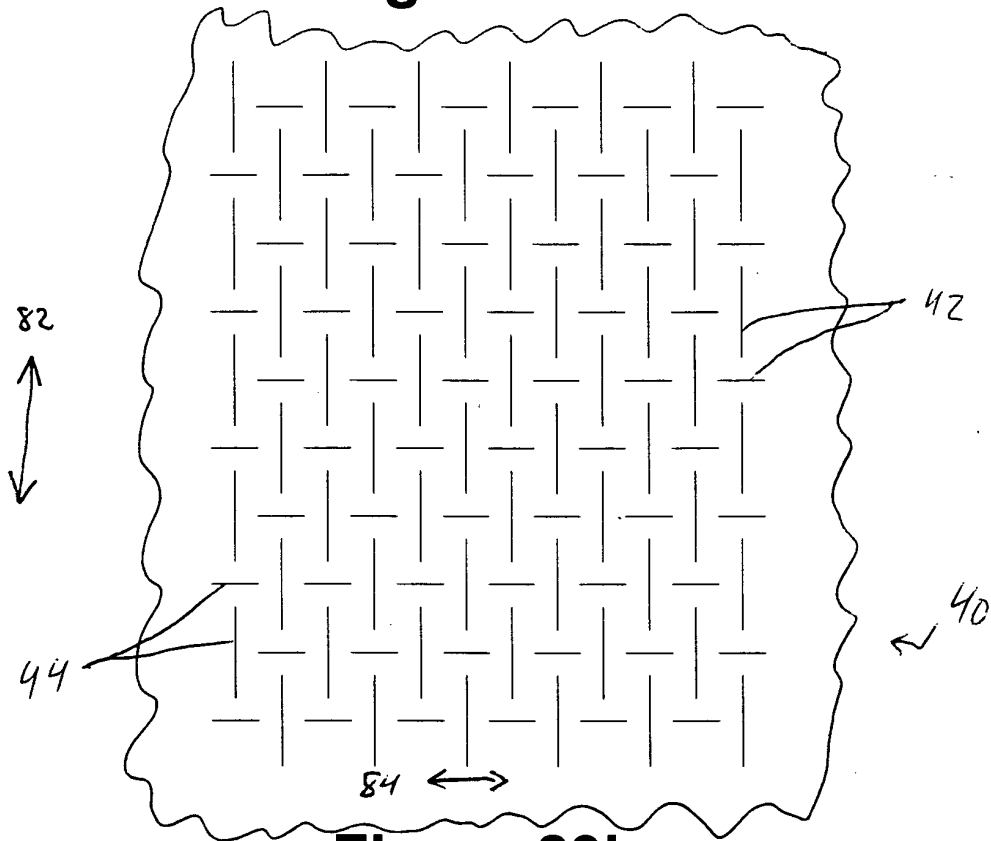


Figure 29b

